

READ AND FOLLOW ALL SAFETY INSTRUCTIONS IMPORTANT SAFEGUARDS

ALL SERVICING SHOULD BE PERFORMED BY QUALIFIED PERSONNEL

- This product is intended for use with lighting fixtures controlled by an Emergency panel. Any switching between Backup Power and Utility Power must be done upstream of device.
- All wiring connections and mounting styles must be in accordance with the National Electrical Code (NEC), National Fire Protection Association (NFPA), National Electrical Safety Code, state and local codes, and any other regulations set forth by the local Authority Having Jurisdiction (AHJ).
- Per NFPA 70E, the use of Personal Protective Equipment (PPE) may be required. Check state and local codes.
- The load's operating voltage must be the same as the Emergency Power Input voltage.
- To reduce the risk of electrical shock, fire, and injury to persons:
 1. Disconnect all sources of power before servicing,
 2. Mount this device in locations and at heights where it will not be readily accessible to tampering by unauthorized personnel,
 3. Do not mount near gas or electric heaters,
 4. Do not let any wires touch hot surfaces, and
 5. Do not use outdoors
- The use of accessory equipment not recommended by the manufacturer may cause an unsafe condition.
- Do not use this device for other intended use.

SAVE THESE IMPORTANT SAFETY INSTRUCTIONS

ELCR Series

5 AMP AUTOMATIC LOAD CONTROL RELAY



Electrical Specifications

Mechanical Specifications


Normal Power Supply Voltage Normal Power Current Draw Normal Power Operating Frequency	120-277VAC 24mA max 50/60Hz
Emergency Power Supply Voltage Emergency Power Current Draw Emergency Power Operating Frequency	120-277Vac 88mA max 50/60Hz
Remote Test Input (Class 2, Dry Contact)	ELCTB or other switching method ^{1,2}
Feedback/Dimmer Contact Switching Capability (Dry Contact Output 1, N/O - N/C)	1A Resistance @ 30Vdc
Relay Contact SPST	5A Electronic/LED Ballast @ 120-277VAC 5A Ballast @ 120-277VAC

Housing	UL accepted for use in Plenum
Wire	16" 600V Rated
Operating Temperature	-30° to 140° F (-35° to 60° C)
Humidity Range	5 to 95% (noncondensing) Rated for dry and damp locations only
Approvals	UL listed, UL924, C-UL

1: If not using ELCTB Remote Test Button (sold separately), switching methods should be rated for at least 24Vdc. External voltage should not be supplied to this input. No specific current rating is required.
2: To maintain Class 2, a maximum of 45 total test inputs can be wired in parallel per ELCTB

Installation

ALL INSTALLATIONS AND WIRING SHOULD BE DONE BY QUALIFIED PERSONNEL

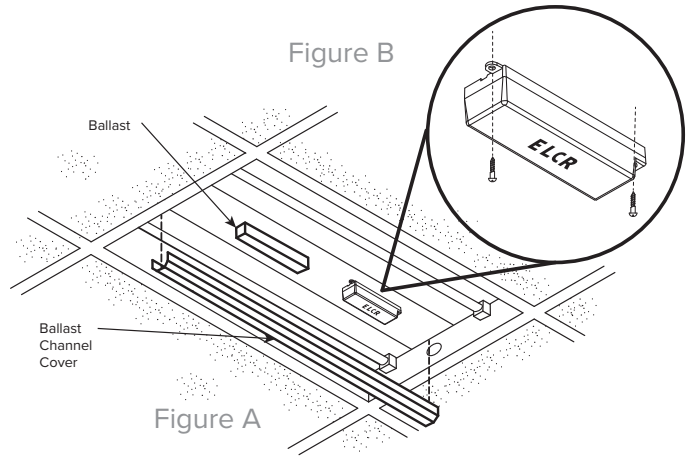

- STEPS
1. Remove all sources of power.
 2. Remove ballast channel cover.
 3. Mount ELCR as shown in Figures A and B.
 4. Wire the ELCR using an illustration from the "Typical Applications" section on page 3 or similar setups for different application.
 5. Before applying power, review the Important Safeguards at the beginning of this document.
 6. Finish installation as required by the NEC, NFPA, state, local, and other codes. Test the ELCR using the "Test Procedure" on page 4.

OPERATION

The ELCR will activate an Emergency lighting load automatically upon the loss of Normal Power. If Normal Power is absent, the status of the load cannot be overridden. However, if the Normal Power is present, the Emergency lighting load can be controlled by other means in order to use it as a Normal Lighting load, depending on the wiring setup. When used as Normal Lighting, a two second delay will keep the Load on after Wall Switch is turned off, to perform a Self-Test on the unit. When Normal Power is present, the N/O status contact will automatically close. Therefore, when Normal Power is absent, the N/O status contact will open (perfect for 0-10V dimming controls). The N/C contact will operate opposite of N/O. A red LED indicates the Emergency Power is available. A Green LED indicates that Normal Power is present. A Yellow LED copies the status of the load; if the LED is on, the load is on.

MAINTENANCE

No routine maintenance is required for the ELCR. Occasionally, this device should be tested to ensure that it works correctly in accordance with national and local codes.




ELCR Series


5 AMP AUTOMATIC LOAD CONTROL RELAY

Typical Applications

Using Emergency Lighting as Normal Lighting

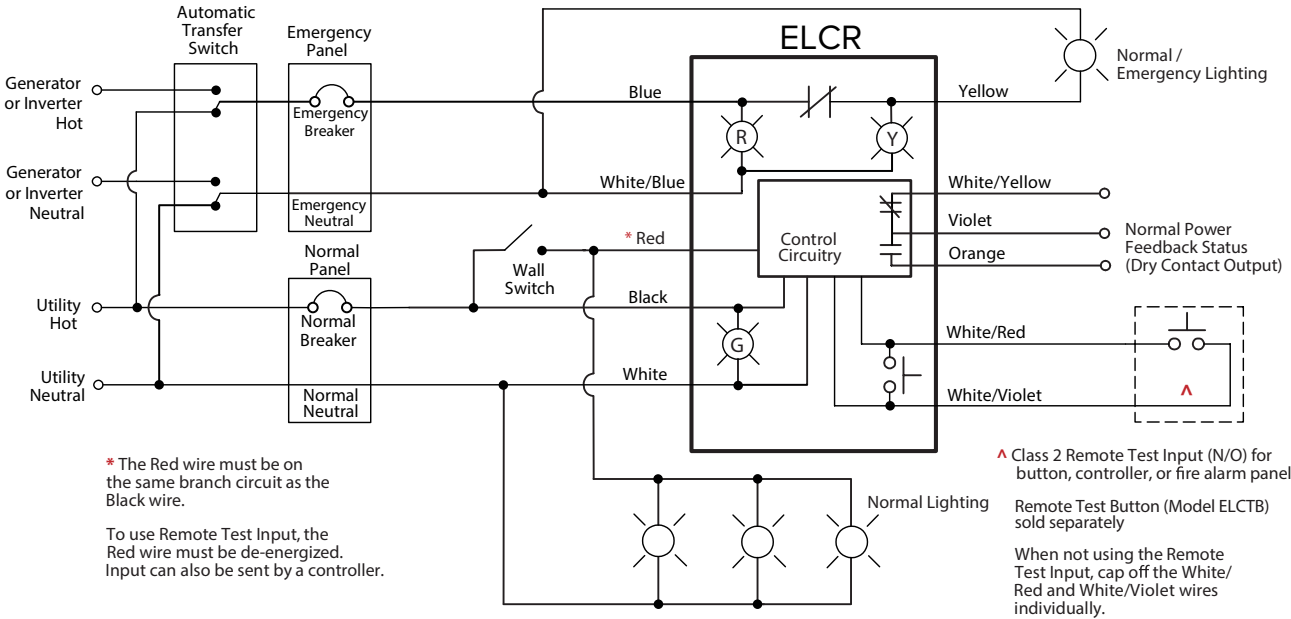

Overriding a 0-10Vdc Dimmer

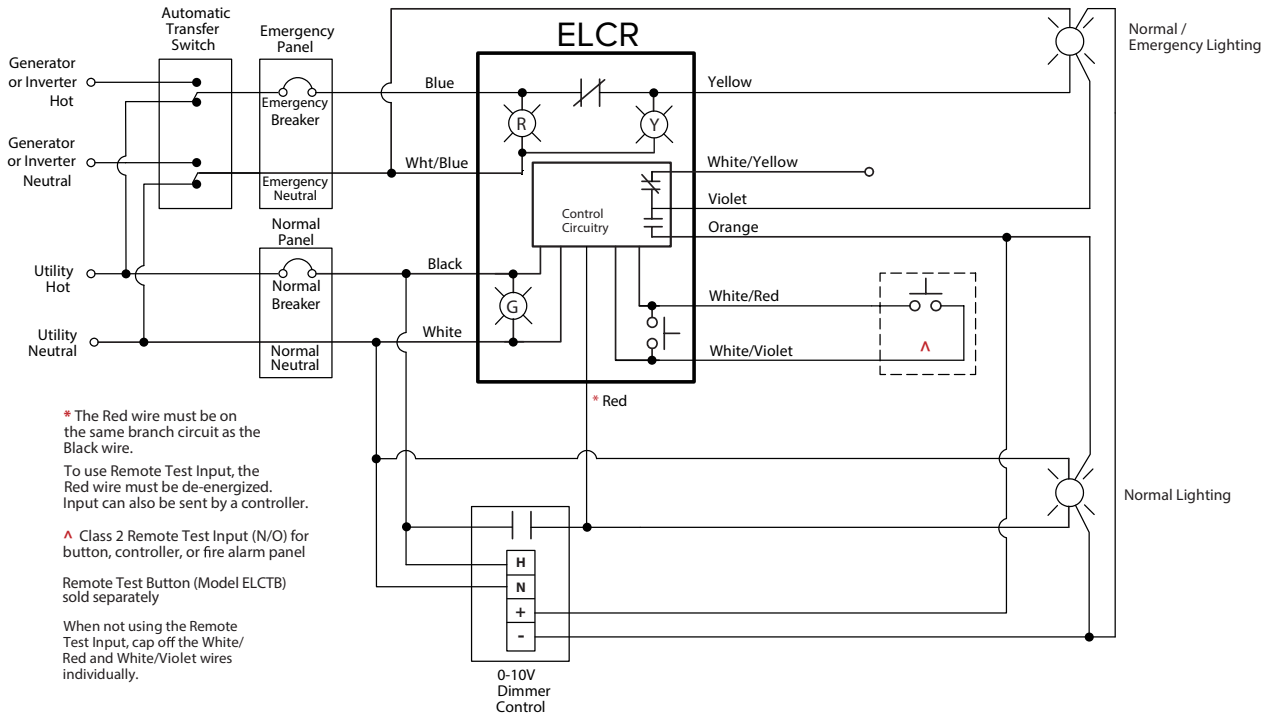

ELCR Series

5 AMP AUTOMATIC LOAD CONTROL RELAY

Wiring Discriptions

Wire Color	Description	Notes
BLACK	Normal Hot	N/A
RED	Wall Switch Input (Self-Test Input)	Must be from same branch circuit as Black and White. When switched off, a two second delay keeps the load on to test Emergency Power. Does not test Feedback/Dimmer Output
WHITE	Normal Neutral or other Phase	N/A
BLUE	Emergency Hot	N/A
YELLOW	Emergency Hot Switched to load	Switches out the voltage put in on Blue
WHITE/BLUE	Emergency Neutral or other Phase	N/A
WHITE/VIOLET	Remote test Input (Class 2, Dry Contact Input)	When wiring multiple units together, White/Violet must be a shared common. Test is performed when Input is CLOSED
WHITE/RED		
ORANGE (N/O) VIOLET (C) WHITE/YELLOW (N/C)	Feedback / Dimmer Contact	N/O is OPEN when Normal Power is Absent or Remote test Input is CLOSED. N/C opposite. N/O is CLOSED when Normal Power is Present or Remote Test Input is OPEN. N/C opposite. Wall Switch Input does not test this output.

To test the ELCR periodically, repeat the appropriate Test Procedure above in accordance with national and local codes.

Troubleshooting

Condition	Action
Red LED is OFF	<ul style="list-style-type: none"> Check Emergency Power Input wiring (Blue & White/Blue wires) and voltage
Green LED is OFF	<ul style="list-style-type: none"> Check Normal Power Input wiring (Black and White wires) and voltage.
Yellow LED is ON but Load is OFF	<ul style="list-style-type: none"> Check bulbs and ballast. Check Load wiring (Yellow wire and Load's neutral). Verify Load's operating voltage is the same as the Emergency Power Input Voltage. Replace unit
Load is ON but Yellow LED is OFF	<ul style="list-style-type: none"> Replace Unit
Yellow LED and Load do not turn on when being tested	<ul style="list-style-type: none"> Check bulbs and ballast Check wiring connections if using a remote test option Press local test button on the unit Replace unit
Yellow LED and Load will not turn OFF	<ul style="list-style-type: none"> Verify status of Normal Power Input Open Wall Switch Input Verify that no test inputs are stuck closed. (i.e. Remote Test is not closed).

Testing Procedures

Four Options to test the ELCR after Installation

Initial Test for Correct Wiring

Apply Emergency Power to the Emergency Power Input and Normal Power to the Normal Power Input. (If using the Wall Switch Input, apply Normal Power to the switch also, but keep the switch OFF/OPEN.)

- The Red LED (Emergency Power available) should be ON.
- The Green LED (Normal Power available) should be ON.
- The Yellow LED (Load Status) should be OFF.
- The Load should be OFF.
- The Feedback/Dimmer Contact (N/O) should be CLOSED.

Local Test Button

- Turn switched circuit OFF. Emergency light should be OFF.
- Press and hold "Local Test Button"
- Emergency light should turn ON.
- Release "Local Test Button" and emergency light should turn OFF.

Remote Test Button

(Model ELCTB - sold separately)

- Turn switched circuit OFF. Emergency light should be OFF.
- Press and hold "Remote Test Button"
- Emergency light should turn ON.
- Release "Remote Test Button" and emergency light should turn OFF.

Wall Switch

- Turn ON wall switch if not already on.
- Emergency light should turn ON.
- Turn wall switch OFF.
- Emergency light will remain on for two seconds before turning off.