



## LED Emergency Light (LUMEL Series)



### BEFORE YOU BEGIN

Read these instructions completely and carefully.

When using electrical equipment, basic safety precautions should always be followed including the following.



#### WARNING/AVERTISSEMENT

- Do not let power supply cords touch hot surfaces.
- Do not mount near gas or electric heaters.
- Equipment should be mounted in locations and at heights where it will not readily be subject to tampering by unauthorized personnel.
- The use of accessory equipment not authorized by the manufacturer may cause an unsafe condition.
- Do not use this equipment for other than its intended purpose.
- Servicing of this equipment should be performed by qualified service personnel.
- Do not use outdoors.
- Max Mounting Height: 9ft.

#### INSTALLER:

- See unit label for additional model specifications

#### WARNING:

- This product contains chemicals known to the State of California to cause cancer, birth defects and/or other reproductive harm. Thoroughly wash hands after installing, handling, cleaning, or otherwise touching this product.

## Save These Instructions


Use only in the manner intended by the manufacturer. If you have any questions, contact the manufacturer.



## Installation - J-box Mounting



- ① Feed fixture leads through main bottom case and connect AC power supply.
- ② Connect wires through the J-Box. Main bottom case on the J-Box and secure with screws.

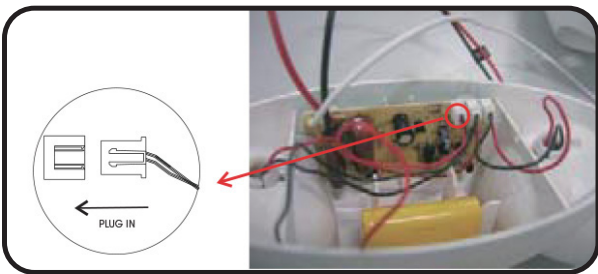


- ③ Connect battery before continuous AC power can be provided to the unit.



- ④ Align snaps and push housing directly onto main bottom case. Apply continuous AC power and press "TEST" button to check light.

## Installation - Conduit

- ① Secure main bottom case to wall surface. Route wires through hole in conduit flange and make conduit connection.

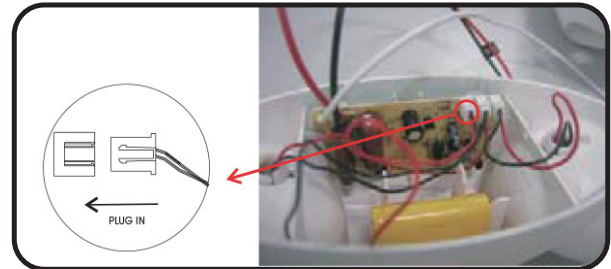


- ② Connect battery before continuous AC power can be provided to the unit.




- ③ Align snaps and push housing directly onto main bottom case. Apply continuous AC power and press "TEST" button to check light.

**WARNING:**  
Unused wires must be capped using enclosed wire nuts.

## Wiring Diagram for LED Emergency Light

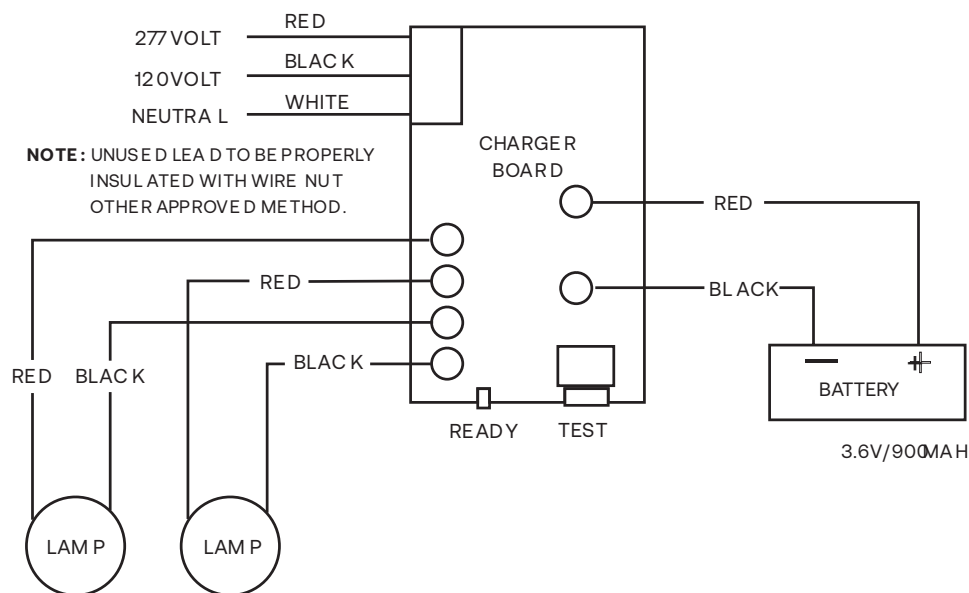

## Wiring Diagram for LED Emergency Light with Remote Capacity

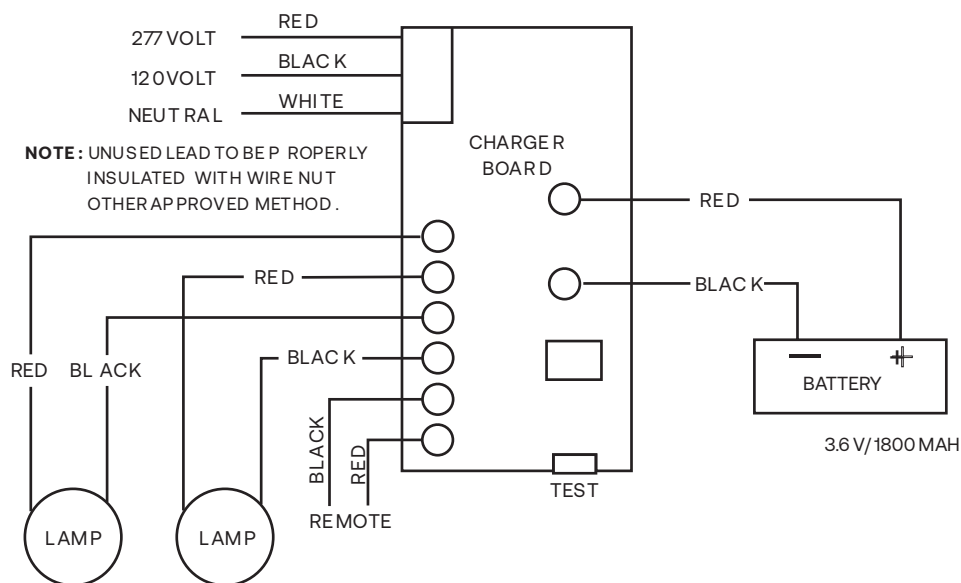

## Operation

- ① During an electrical power failure, the lamps will automatically come on for a minimum of 90 minutes.
- ② To test, depress the "TEST" switch. The emergency lamps will illuminate. When the switch is released, the lamps will go off.



### RECYCLING INFORMATION

All steel, aluminum, and thermoplastics parts are recyclable. All cartons contain recycled materials. Please recycle responsibly.

Specifications subject to change without notice.