



LED Emergency Light (LUMELRCSQ Series)



BEFORE YOU BEGIN

Read these instructions completely and carefully.

When using electrical equipment, basic safety precautions should always be followed including the following.



WARNING/AVERTISSEMENT

- Rated for temperature range of 10°C-40°C (50°F-104°F) and suitable for use in an application that is designated as a damp location area as defined by NED Article 100, Location, Damp.
- Used indoors.
- Equipment should be mounted in locations and at heights (Max: 8ft) where it will not be subject to tampering by unauthorized personnel.
- Do not mount near gas or electric heaters.
- The use of accessory equipment is not recommended by the manufacturer and may cause an unsafe condition.
- Do not use this equipment for anything other than its intended use.
- Servicing of this equipment should be performed by qualified personnel.
- Disconnect AC power before servicing.

INSTALLER:

- See unit label for additional model specifications

WARNING:

- This product contains chemicals known to the State of California to cause cancer, birth defects and/or other reproductive harm. Thoroughly wash hands after installing, handling, cleaning, or otherwise touching this product.

Save These Instructions

Use only in the manner intended by the manufacturer. If you have any questions, contact the manufacturer.


IMPORTANT:

The battery in this unit may not be fully charged. After electricity is connected to the unit, let battery charge up to 24 hours. Then the normal operation of this unit should take effect. To check press the "TEST" button and the lights on the unit should turn ON.




J-Box Mounting

NOTE: FIRST TURN OFF ELECTRICITY

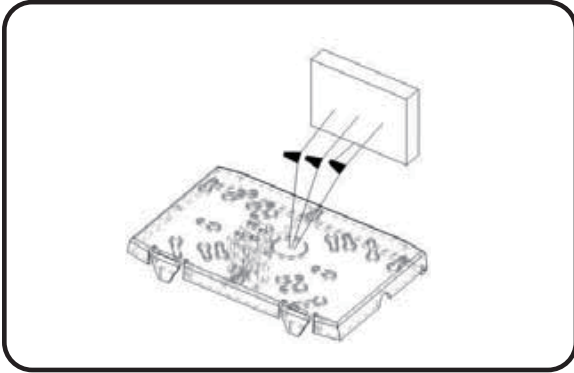


① Open the back-plate and knock-out the hole in the center of the back-plate to run the AC wiring.

② Locate the AC wire connections and feed through the hole.

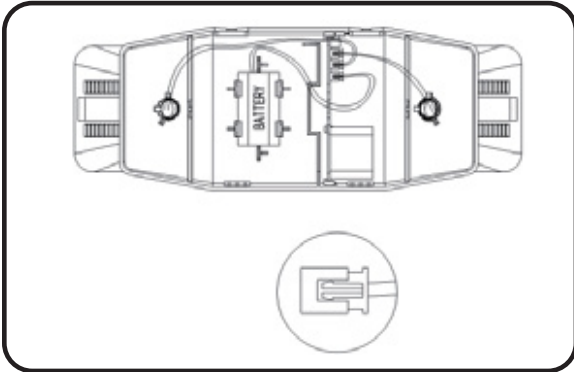


③ Connect the AC wires to the supply using the wire-nuts provided. Connect the battery.

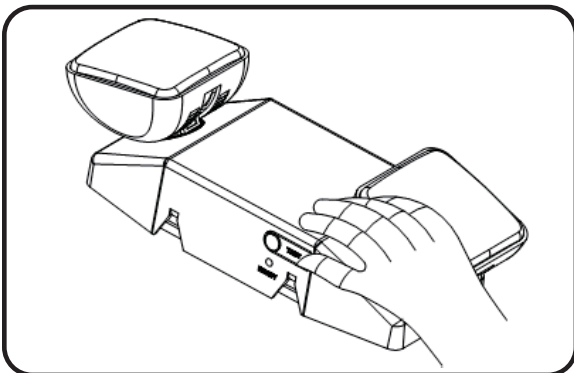

④ Install the housing onto the back-plate, AC power can now be applied to the unit.


Conduit

NOTE: FIRST TURN OFF ELECTRICITY

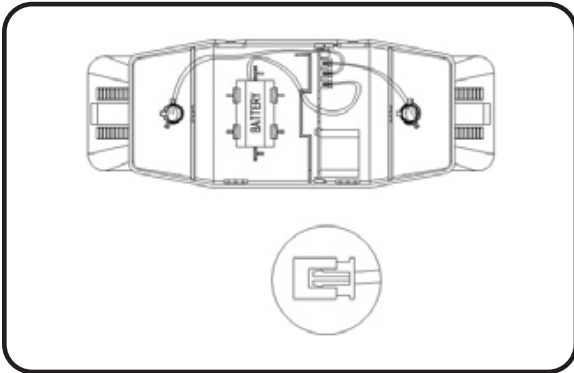

① Secure Base Plate to wall surface. Route wires through hole in conduit flange and make conduit connection. Use flexible conduit only.

② Connect Battery before continuous AC power is being supplied to the unit.

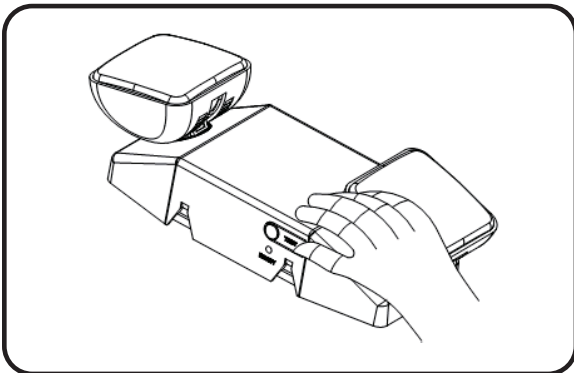

③ Align snaps and push housing directly onto the Base Plate. Apply continuous AC power and press "TEST" button to check light.


WARNING: UNUSED WIRES MUST BE CAPPED USING ENCLOSED WIRE NUTS.

Operation

- ① During an electrical power failure, the lamps on the unit will automatically come ON for a minimum of 90 minutes.
- ② To test the unit, let it charge correctly with AC power supply for a minimum of 24 hours after its first installation and then depress the "TEST" switch, the emergency lamps will illuminate. When the switch is released, the lamps will turn OFF.

Wiring Diagrams

LED EMERGENCY LIGHT WITH REMOTE CAPACITY

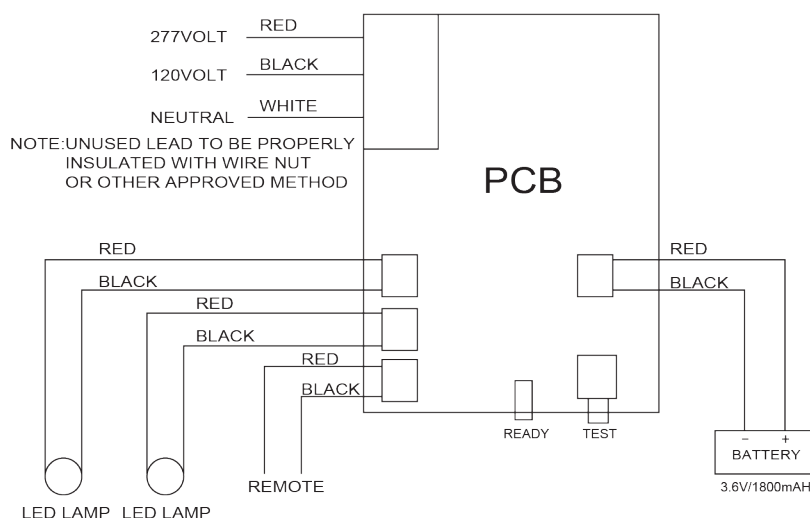

RECYCLING INFORMATION

All steel, aluminum, and thermoplastics parts are recyclable.
All cartons contain recycled materials.
Please recycle responsibly.

Specifications subject to change without notice.