Lighting Controls

DATE:	LOCATION:
TYPE:	PROJECT:
CATALOG #:	

BTSMP SERIES

BLUETOOTH® HIGH MOUNT OUTDOOR PASSIVE INFRARED FIXTURE SENSOR

FEATURES

- Passive Infrared (PIR) sensing technology provides excellent major motion detection
- Wireless programming using NX Lighting Controls mobile app
- 0-10V Dimming control
- Single/Dual motion sensor timer modes
- Daylight sensor with multiple daylight harvesting modes
- 360° and aisle coverage options
- · Supports low temperature, water-tight and outdoor applications





BTSMP-HMO

BTSMP-HMO-A



SPECIFICATIONS

CONSTRUCTION

- ABS (UL-945VA) flame class rating, UV inhibitors
- 4.0 oz (113.0g)
- White, Black, Gray finishes available
- External: 1.0" (25.4mm) H, 3.5"(84.6mm) W
- Internal Thread: 1.3" (27.94mm) L, 1.4" (35.6mm) W

ELECTRICAL

- Low Voltage sensors: 12-32VDC (Requires Dim to Off driver with auxiliary power or low voltage power supply - Not included)
- Dimming: 0-10V; Capable of sinking up to 30mA
- Bluetooth Radio: V5.0

OPERATION

- Indoor/Outdoor use
- 1:1.4 (Mounting Height : Coverage Radius); Up to 45ft Indoors, 40ft Outdoors; Minimum Mounting Height: 16ft
- Operating temperature: -40°F to 149°F (-40°C to 65°C)
- Wireless programming of sensor settings using NX Lighting Controls mobile app. Maximum programming distance: 45 Ft
- Easy to use slider controls for sensor settings

OPERATION (CONTINUED)

- Motion sensor and photosensor test modesConfigurable LED motion indicator
- Single/Dual Motion Sensor Timer Modes
 - Single Timer Mode: Timer (0 sec -30 mins), Level Adjustment (0-100%)
 - Dual Timer Mode: Timer 1 (0 sec -30 mins), Level Adjustment (0-100%), Timer 2 (0 min - 5 hrs)
- Multiple Daylight Harvesting Modes
 - Full range dimming with auto configuration (closed loop operation)
 - · Legacy dimming (open loop operation)
 - Dusk to dawn (On/Off operation)
 - Disabled (Default)
- Device Cloning: Sensor settings can be saved to device profiles and then cloned to other sensors
- Patented Intelliscope[™] technology showing real-time occupancy data
- Security
 - Passcode protection to prevent unwanted changes
- Factory Defaults: Sensor can be set to factory defaults using the app.
- Over the Air (OTA) firmware updatable

OPERATION (CONTINUED)

 Dual element pyrometer and spherical Fresnel lens designed for robust detection of person walking

DAYLIGHT SENSORRange: 1 to 50fc or 5 to 500fc

CERTIFICATIONS

- Conforms with UL STD 508, UL STD 244A
- IP65 Rated

WARRANTY

5 year limited

Current 🗐

currentlighting.com

© 2022 HLI Solutions, Inc. All rights reserved. Information and specifications subject to change without notice. All values are design or typical values when measured under laboratory conditions


Lighting Controls

DATE:	LOCATION:
TYPE:	PROJECT:
CATALOG #:	·


BTSMP SERIES


BLUETOOTH® HIGH MOUNT OUTDOOR PASSIVE INFRARED FIXTURE SENSOR

ORDERING GUIDE

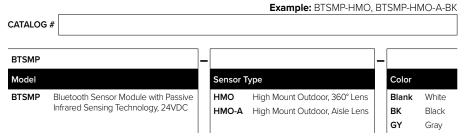


DIMENSIONS

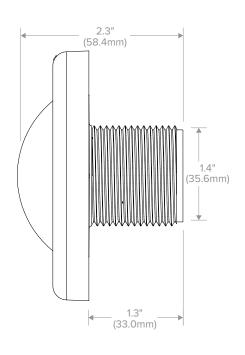

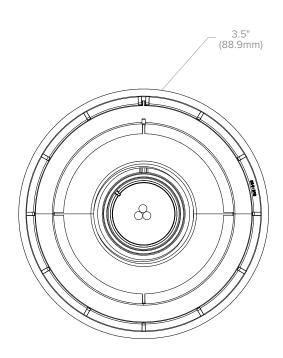


ADDITIONAL INFORMATION

Coverage Patterns



Sensor Lens Coverage and Detection Patterns When Mounted at 40ft and 45ft with Standard Lens

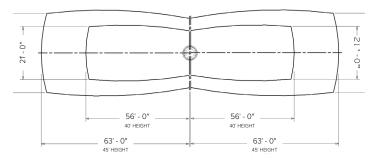

Sensor Lens Coverage and Detection Patterns When Mounted at 40ft and 45ft with Aisle Lens (Top Down View)

Current 🗐

currentlighting.com

© 2022 HLI Solutions, Inc. All rights reserved. Information and specifications subject to change without notice. All values are design or typical values when measured under laboratory conditions.


Lighting Controls

BTSMP SERIES


BLUETOOTH® HIGH MOUNT OUTDOOR PASSIVE INFRARED FIXTURE SENSOR

ADDITIONAL INFORMATION (CONTINUED)

Wiring Diagrams

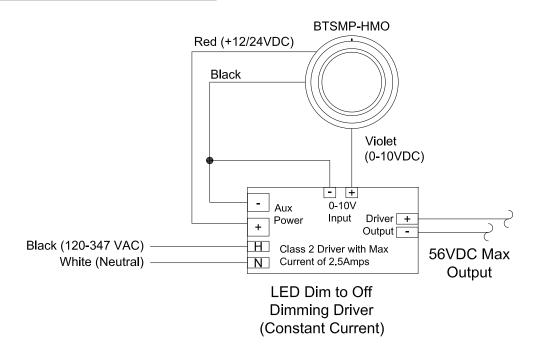

BTSMP Sensor Connected to Dim to OFF Driver with Aux Supply (+12/24VDC)

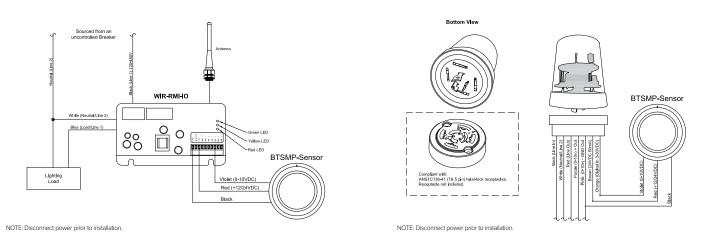

wiSCAPE® Wiring Diagram with WIR-RMI-IO with a BTSMP Sensor

wiSCAPE Wiring Diagram with WIR-RME-L with a BTSMP Sensor

Default Settings

Occupancy Sensor	Enabled	
Occupancy Sensor Sensitivity	7	
Occupancy Sensor Timeout	8 Minutes	
Occupied Dim Level	100%	
Unoccupied Dim Level	0% (OFF)	
Daylight Sensor	Disabled	

Current 🗐

currentlighting.com

© 2022 HLI Solutions, Inc. All rights reserved. Information and specifications subject to change without notice. All values are design or typical values when measured under laboratory conditions. Page **3** of **3** Rev 01/17/23 **1902A_BTSMP-HMO_SPEC_R02**