

# RTS-B Series Poles

ROUND TAPERED STEEL

DATE:	LOCATION:
TYPE:	PROJECT:
CATALOG #:	

## APPLICATIONS

- Lighting installations for side and top mounting of luminaires with effective projected area (EPA) not exceeding maximum allowable loading of the specified pole in its installed geographic location

## CONSTRUCTION

- SHAFT:** One-piece tapered steel with round cross section, Minimum yield of 55,000 psi; Steel base plate with axial bolt circle slots welded flush to pole shaft having minimum yield of 36,000 psi (ASTM A36) Pole shafts taper at .14"/ft.

### GROUP 1

- ANCHOR BOLTS:** Supplied with (4) galvanized anchor bolts with minimum yield of 55,000 psi (ASTM F1554). Galvanized hardware with two washers and two nuts per bolt for leveling
- BOLT COVERS:** Individual anchor bolt nut covers provided as standard
- BASE COVER:** Optional two-piece square base cover available
- POLE CAP:** Pole shaft supplied with removable cover when applicable; Tenon and post-top configurations also available
- HANDHOLE:** 4" X 6.5" handhole opening with cover and grounding provision. The handhole is located 18" from the base of the pole.

### GROUP 2




- ANCHOR BOLTS:** Supplied with (3) galvanized anchor bolts with minimum yield of 55,000 psi (ASTM F1554). Galvanized hardware with two washers and two nuts per bolt for leveling. Top nut is acorn nut.
- POLE CAP:** 3" pole top standard; Supplied with removable cover when applicable; Tenon configurations also available
- HANDHOLE:** 3" X 5" handhole opening with cover and grounding provision. The handhole is located 18" from the base of the pole.

### GROUP 3

- ANCHOR BOLTS:** Supplied with (4) galvanized anchor bolts with minimum yield of 55,000 psi (ASTM F1554). Galvanized hardware with two washers and two nuts per bolt for leveling
- BASE COVER:** Two-piece square base cover supplied as standard.
- POLE CAP:** Pole shaft supplied with removable cover when applicable; Tenon and post-top configurations also available
- HANDHOLE:** 4" X 6.5" handhole opening with cover and grounding provision. The handhole is located 18" from the base of the pole.

## FINISH

- Durable thermoset polyester powder coat paint finish with nominal 3.0 mil thickness
- Powder paint prime applied over "white metal" steel substrate cleaned via mechanical shot blast method
- Decorative finish coat available in six standard colors; Custom colors available, RAL number preferred

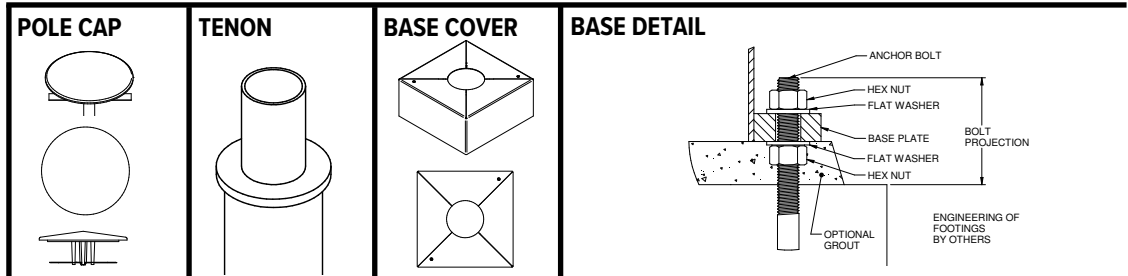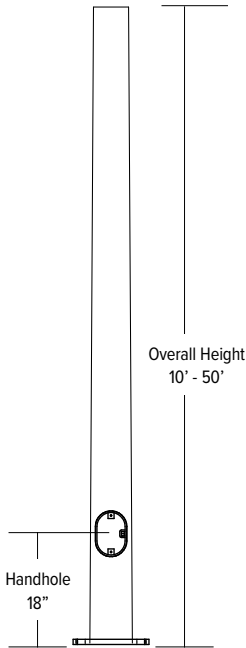

## ORDERING INFORMATION


ORDERING EXAMPLE:

**RTS-B - 20 - 65 - A - 2 - S2 - DBT - SBC**

Reference page 2 for available configurations

SERIES	HEIGHT	SHAFT	THICKNESS	MOUNTING	FINISH	OPTIONS
RTS-B Round Tapered Steel Pole Beacon Outdoor	Reference page 2 Ordering matrix	Bottom O.D. Reference page 2 Ordering matrix	Reference page 2 Ordering matrix	<b>1</b> Single arm mount <b>2</b> Two fixtures at 180° <b>2L</b> Two fixtures at 90° <b>3T</b> Three fixtures at 90° <b>3Y</b> Three fixtures at 120° <b>4</b> Four fixtures at 90° <b>TA</b> Tenon (2.375" OD) <b>TB</b> Tenon (2.875" OD) <b>TC</b> Tenon (3.5" OD) <b>OT</b> Open Top (includes pole cap)	<b>BLT</b> Black Matte Textured <b>BLS</b> Black Gloss Smooth <b>DBT</b> Dark Bronze Matte Textured <b>DBS</b> Dark Bronze Gloss Smooth <b>GTT</b> Graphite Matte Textured <b>LGT</b> Light Grey Matte Textured <b>LGS</b> Light Grey Gloss Smooth <b>PSS</b> Platinum Silver Smooth <b>WHT</b> White Matte Textured <b>WHS</b> White Gloss Smooth <b>VGT</b> Verde Green Textured <b>Color Option</b> <b>CC</b> Custom Color	<b>GFI</b> <sup>1</sup> 20 Amp GFCI Receptacle and Cover <b>EHH</b> <sup>1</sup> Extra Handhole <b>C05</b> <sup>1</sup> .5" Coupling <b>C07</b> <sup>1</sup> .75" Coupling <b>C20</b> <sup>1</sup> 2" Coupling <b>MPB</b> <sup>2</sup> Mid-pole Luminaire Bracket <b>VM2</b> 2nd mode vibration damper <b>LAB</b> Less Anchor Bolts <b>SBC</b> Square Base Cover

### MOUNTING ORIENTATION



1 Specify option location using logic found on page 2 (Option Orientation)

### DRILL PATTERN

- B1** Cruiser, "AM" arm
- B3** 2 bolt (2-1/2" spacing), Viper "A" arm
- S2** 2 bolt (3-1/2" spacing), Viper "AD" arm
- UDP** Universal Drill Pattern

### ACCESSORIES- Order Separately

Catalog Number	Description
VM2SXX	2nd mode vibration damper

<sup>2</sup> Not available on the following poles: 20ft 6" .188, 25ft 7" .188, 30ft, 8" .188, 35ft 9.5" .125

# RTS-B Series Poles

ROUND TAPERED STEEL


DATE:	LOCATION:
TYPE:	PROJECT:
CATALOG #:	

## ORDERING INFORMATION Cont.


Catalog Number	Height		Nominal Shaft Dimensions	Wall Thick-ness	Bolt Circle (suggested)	Bolt Circle (range)	Base Plate Square	Anchor bolt size	Bolt Projection	Pole weight
	Feet	Meters								
Group 1										
RTS-B-20-65-A	20	6.1	6.5" x 3.7"	.119"	10"	9.5" - 13.0"	12.5" - Square	1" x 36" x 4"	4.25"	187
RTS-B-25-70-A	25	7.6	7.0" x 3.5"	.119"	11"	10" - 13.0"	12.5" - Square	1" x 36" x 4"	4.25"	226
RTS-B-30-80-A	30	9.1	8.0" x 3.8"	.119"	12"	11" - 13.5"	12.5" - Square	1" x 36" x 4"	4.25"	290
RTS-B-35-85-A	35	10.7	8.5" x 3.6"	.119"	13"	11.5" - 13.5"	12.5" - Square	1" x 36" x 4"	4.25"	340
RTS-B-39-90-A	39	11.9	9.0" x 3.5"	.119"	13"	12.5' - 13.5"	12.5" - Square	1" x 36" x 4"	4.25"	382
Group 2										
RTS-B-10-50-A	10	3.0	4.4" x 3.0"	.119"	8"	8"	8.5" - Triangular	3/4" x 17" x 3"	3.5"	60
RTS-B-12-50-A	12	3.7	4.7" x 3.0"	.119"	8"	8"	8.5" - Triangular	3/4" x 17" x 3"	3.5"	70
RTS-B-14-50-A	14	4.3	5.0" x 3.0"	.119"	8"	8"	8.5" - Triangular	3/4" x 17" x 3"	3.5"	80
RTS-B-16-50-A	16	4.9	5.2" x 3.0"	.119"	8"	8"	8.5" - Triangular	3/4" x 17" x 3"	3.5"	95
RTS-B-18-50-A	18	5.5	5.5" x 3.0"	.119"	8"	8"	8.5" - Triangular	3/4" x 17" x 3"	3.5"	110
RTS-B-20-60-A	20	6.1	5.8" x 3.0"	.119"	8"	8"	8.5" - Triangular	3/4" x 17" x 3"	3.5"	125
Group 3										
RTS-B-25-70-B	25	7.6	7.0" x 3.5"	.179"	10.0"	9.5 - 10.5"	10.88" - Square	1" x 36" x 4"	4.25"	280
RTS-B-30-80-B	30	9.1	8.0" x 3.8"	.179"	11.0"	10.5 - 11.5"	11.5" - Square	1.25" x 42" x 6"	5.0"	380
RTS-B-35-95-A	35	10.7	9.5" x 4.6"	.119"	13.0"	12.5 - 13.5"	13.0" - Square	1" x 36" x 4"	4.25"	370
RTS-B-40-90-A	40	12.2	9.0" x 3.6"	.119"	12.5"	12 - 13.0"	12.38" - Square	1" x 36" x 4"	4.25"	355
RTS-B-40-90-B	40	12.2	9.0" x 3.6"	.179"	12.5"	12 - 13.0"	12.38" - Square	1.25" x 42" x 6"	5.0"	515
RTS-B-45-10-A	45	13.7	10.0" x 3.7"	.119"	13.5"	13 - 14.0"	14.0" - Square	1" x 36" x 4"	4.25"	450
RTS-B-50-10-A	50	15.2	10.0" x 3.0"	.119"	13.5"	13 - 14.0"	14.0" - Square	1" x 36" x 4"	4.25"	475
RTS-B-50-10-B	50	15.2	10.0" x 3.0"	.179"	13.5"	13 - 14.0"	14.0" - Square	1.25" x 42" x 6"	5.0"	680

NOTE Factory supplied template must be used when setting anchor bolts. Current will deny any claim for incorrect anchorage placement resulting from failure to use factory supplied template and anchor bolts.


### EHH - EXTRA HANDHOLE



### C05 - C07 - C20 - COUPLING



### VM2 - VIBRATION DAMPER 2ND MODE



Factory installed, internal damper designed to alter pole resonance to reduce movement and material fatigue caused by 2nd mode vibration.


### VM2SXX - VIBRATION DAMPER 2ND MODE



VM2S08 - 8'  
VM2S12 - 12'  
VM2S16 - 16'  
VM2S20 - 20'  
VM2S24 - 24'


Field installed, internal damper designed to alter pole resonance to reduce movement and material fatigue caused by 2nd mode vibration.

### MPB - MID POLE BRACKET




\* Group 1 only

### UNIVERSAL DRILL PATTERN (UDP)

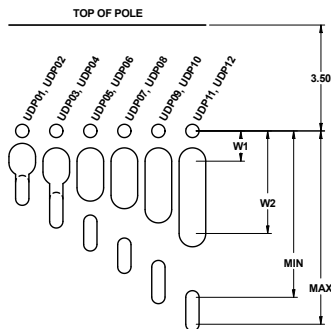


### GFI - 20 AMP GFCI RECEPTACLE & COVER

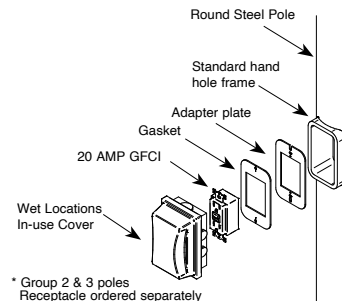

\* Group 2 & 3 poles  
Receptacle ordered separately

### OPTION ORIENTATION

Follow the logic below when ordering location specific options. For each option, include its orientation (in degrees) and its height (in feet). Example: Option C07 should be ordered as: **RTS-B-20-65-A-TA-DB-C05-0-15** (.5" coupling on the handhole/arm side of pole, 15 feet up from the pole base) 1' spacing required between option. Consult factory for other configurations.



TWO BOLT MOUNTING WITH CENTER WIREWAY		Universal Mounting Patterns					
MOUNTING HARDWARE		UDP01	UDP03	UDP05	UDP07	UDP09	UDP11
3/8" OR LESS		UDP02	UDP04	UDP06	UDP08	UDP10	UDP12
"MIN" ATTACHMENT DIMENSION		1.69	2.25	3.00	3.76	4.50	5.50
"MAX" ATTACHMENT DIMENSION		2.24	2.99	3.75	4.49	5.49	6.00
W1 (Wireway min)		0.85	1.00	1.00	1.00	1.00	1.00
W2 (Wireway max)		1.05	1.36	1.88	2.13	2.60	3.00


For more information about pole vibration and vibration dampers, please consult our website.  
Due to our continued efforts to improve our products, product specifications are subject to change without notice.  
Unwrap poles immediately upon receipt to avoid condensation build up and possible corrosion

# RTS-B Series Poles

ROUND TAPERED STEEL

DATE:	LOCATION:
TYPE:	PROJECT:
CATALOG #:	


## ASCE7-05 WIND MAP

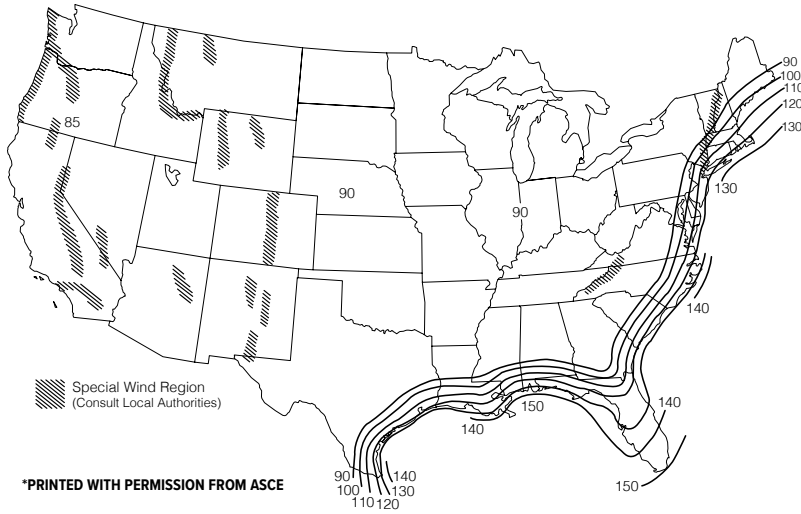


**HAWAII – 105 mph**  
**PUERTO RICO – 145 mph**

## FLORIDA REGION WIND MAP

- Florida region wind map above is based upon 3-second gust winds and the 2017 Florida Building Code

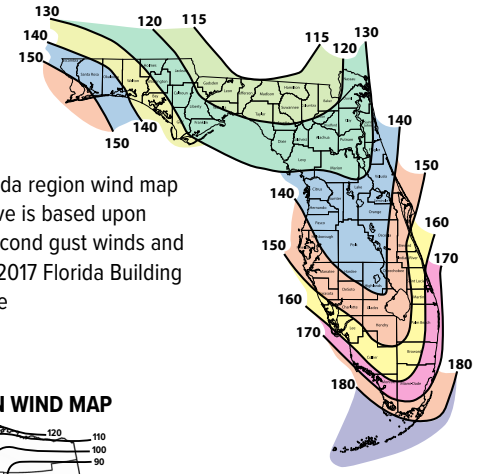

## ALASKA REGION WIND MAP

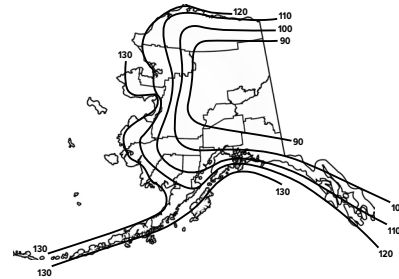

ASCE 7-05 wind map EPA Load Rating - 3 second gust wind speeds									
Catalog Number	Height	85	90	100	110	120	130	140	150
RTS-B-20-65-A	20	23.1	21.5	17.4	14.4	10.0	8.3	7.0	6.0
RTS-B-25-70-A	25	21.2	17.9	14.5	11.8	7.5	6.0	5.1	4.3
RTS-B-30-80-A	30	19.5	15.2	12.1	9.8	7.1	5.8	4.8	3.9
RTS-B-35-85-A	35	14.9	12.7	10.0	8.7	5.3	4.2	3.3	2.6
RTS-B-39-90-A	39	13.4	10.6	8.3	6.5	4.5	3.3	2.4	1.8
RTS-B-10-50-A	10	22.0	21.5	17.4	14.4	12	10.1	8.7	7.5
RTS-B-12-50-A	12	18.8	17.9	14.5	11.8	9.8	8.2	7	6
RTS-B-14-50-A	14	17.7	15.2	12.1	9.8	8.1	6.7	5.6	4.8
RTS-B-16-50-A	16	16.5	12.7	10	8	6.5	5.4	4.5	3.8
RTS-B-18-50-A	18	14.0	10.6	8.3	6.5	5.2	4.2	3.5	2.9
RTS-B-20-60-A	20	12.1	8.9	6.8	5.3	4.1	3.3	2.6	2.2
RTS-B-25-70-B	25	25.0	22.6	18.1	14.7	12.2	10.3	8.8	7.6
RTS-B-30-80-B	30	25.0	25.0	25.0	21.6	18.1	15.4	13.2	11.4
RTS-B-35-95-A	35	20.0	17.7	14.1	11.5	9.4	7.8	6.5	5.4
RTS-B-40-90-A	40	15.5	13.6	10.6	8.3	6.7	5.4	4.4	3.6
RTS-B-40-90-B	40	25.0	25.0	20.2	16.5	13.7	11.4	9.7	8.2
RTS-B-45-10-A	45	12.4	10.8	8.1	6.1	4.8	3.7	2.9	2.1
RTS-B-50-10-A	50	9.5	8.2	5.8	4.2	2.9	2.0	1.2	0.7
RTS-B-50-10-B	50	19.2	17.4	13.6	10.7	8.5	6.9	5.5	4.4

Florida Building Code 2017 EPA Load Rating - 3 second gust wind speeds								
Catalog Number	115	120	130	140	150	160	170	180
RTS-B-20-65-A	25.0	25.0	25.0	21.5	18.3	15.7	13.6	11.9
RTS-B-25-70-A	25.0	23.0	19.2	16.1	13.6	11.5	9.8	8.4
RTS-B-30-80-A	21.1	19.0	15.5	12.8	10.6	8.8	7.3	6.0
RTS-B-35-85-A	17.1	15.3	12.3	9.9	8.0	6.4	5.1	1.0
RTS-B-39-90-A	15.4	13.7	10.8	8.6	6.7	5.2	4.0	3.0
RTS-B-10-50-A	21.8	20.2	17.2	14.7	12.7	11.2	9.7	8.7
RTS-B-12-50-A	17.4	16.7	14.2	12.2	10.5	9.0	8.0	7.0
RTS-B-14-50-A	15.0	14.2	12.0	10.0	8.7	7.5	6.5	5.7
RTS-B-16-50-A	12.2	11.7	9.7	8.2	7.0	6.0	5.2	4.5
RTS-B-18-50-A	11.1	9.7	8.0	6.7	5.5	4.7	4.0	3.5
RTS-B-20-60-A	9.2	8.2	6.7	5.5	4.5	3.7	3.0	2.5
RTS-B-25-70-B	25.0	21.1	17.8	15.2	13.1	11.4	10	8.9
RTS-B-30-80-B	25.0	30.2	25.7	22.2	19.4	17	15	13.4
RTS-B-35-95-A	20.0	16.5	13.9	11.8	10.1	8.7	7.6	6.5
RTS-B-40-90-A	15.5	12.6	10.4	8.6	7.3	6.1	5.2	4.5
RTS-B-40-90-B	25.0	23.5	19.9	17	14.6	12.7	11.1	9.8
RTS-B-45-10-A	12.4	9.9	8	6.5	5.3	4.3	3.5	2.9
RTS-B-50-10-A	9.5	7.4	5.7	4.4	3.3	2.4	1.8	1.2
RTS-B-50-10-B	19.2	16.1	13.3	11.1	9.3	7.8	6.6	5.6

### NOTES

- Allowable EPA, to determine max pole loading weight, multiply allowable EPA by 30 lbs.
- The tables for allowable pole EPA are based on the ASCE 7-05 Wind Map or the Florida Region Wind Map for the 2017 Florida Building Code. The Wind Maps are intended only as a general guide and cannot be used in conjunction with other maps. Always consult local authorities to determine maximum wind velocities, gusting and unique wind conditions for each specific application
- Allowable pole EPA for jobsite wind conditions must be equal to or greater than the total EPA for fixtures, arms, and accessories to be assembled to the pole. Responsibility lies with the specifier for correct pole selection. Installation of poles without luminaires or attachment of any unauthorized accessories to poles is discouraged and shall void the manufacturer's warranty
- Wind speeds and listed EPAs are for ground mounted installations. Poles mounted on structures (such as bridges and buildings) must consider vibration and coefficient of height factors beyond this general guide; Consult local and federal standards
- Wind Induced Vibration brought on by steady, unidirectional winds and other unpredictable aerodynamic forces are not included in wind velocity ratings.
- Extreme Wind Events like, Hurricanes, Typhoons, Cyclones, or Tornadoes may expose poles to flying debris, wind shear or other detrimental effects not included in wind velocity ratings

Due to our continued efforts to improve our products, product specifications are subject to change without notice.