





Type:
Job:
Catalog number:

Approvals:

/	/	/	/	/
Pole	Mounting	Structural Luminaire Option	Finish	Optional Anchor Bolt Covers
				Optional Duplex Receptacle
See page 2			See page 3	

Date:
Page: 1 of 4

Specifications

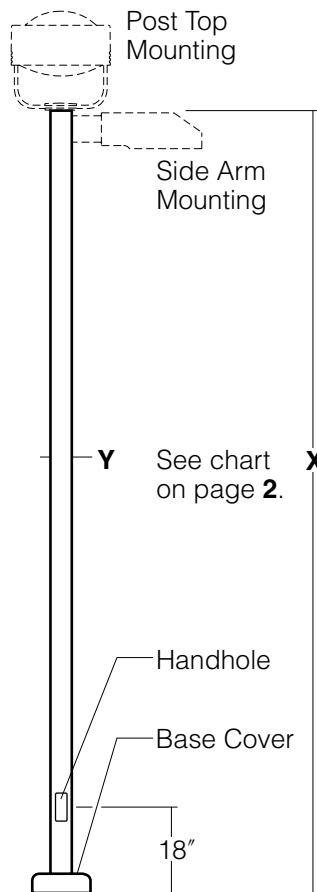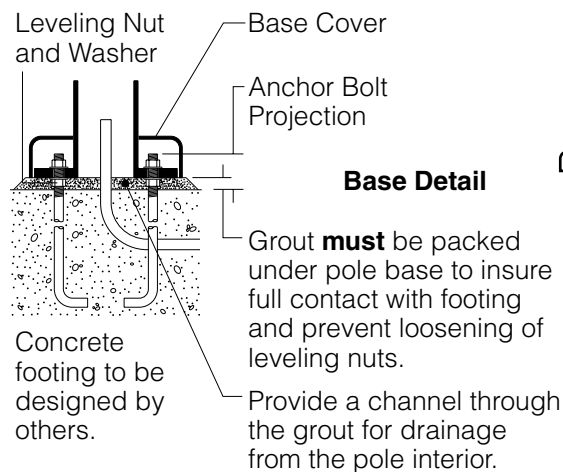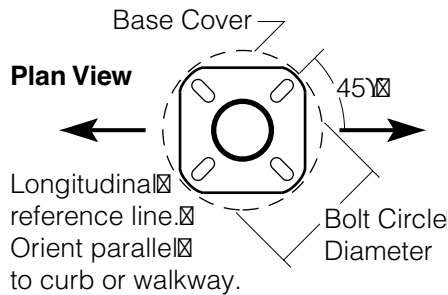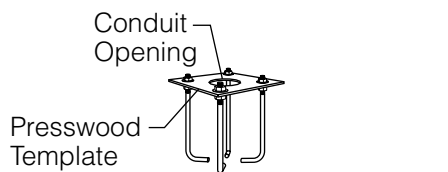

Pole Construction: One-piece non-tapered round shaft of low carbon steel (ASTM-A500 Grade B, 42,000 PSI min. yield) with one flush-welded vertical seam. Shaft is welded to a flat steel anchor base (ASTM-36, 36,000 PSI min. yield).

Base Cover: Base has a two-piece cast aluminum full cover of 319 alloy, secured by stainless steel screws. Optional anchor bolt covers available (see page 3).

Pole Cap: A flush-sided cast aluminum pole cap is provided for side arm mounted luminaires. A rounded cast aluminum pole cap is provided for twin mounted luminaires (NS only).

Handhole: 18" up from base, with a gasketed cover and ground lug. 2" x 4" handhole provided on poles up to 16'. Reinforced 3" x 6" handhole provided on poles 20' and taller.

Anchor Bolts: Four fully galvanized anchor bolts provided (ASTM-36, 36,000 PSI min. yield), complete with eight galvanized nuts, eight galvanized flat washers, and a presswood template.

Strength: Poles will withstand wind loads as listed in chart (see page 2) when luminaires are mounted per fixture installation instructions.

Finish: Super TGIC thermoset polyester powder coat paint applied over a titanated zirconium conversion coating.

CAUTION: Installation of poles without luminaire(s) will compromise pole strength. Any accessories attached to pole, or other modifications will compromise pole strength and may result in pole failure.

Maintenance: A regularly scheduled maintenance program must be established to insure the protective paint coating is intact, corrosion or structural damage has not occurred, and anchor bolt nuts are tight. Failure to do so could lead to pole collapse and serious personal injury.


Certification: Certified UL 1598 in accordance with Article 410 of ANSI/NFPA 70, National Electrical Code.

Type:

Job:

Standard Features

NOTE: All allowable pole and fixture EPAs are derived from the AASHTO standard. Responsibility lies with the specifier for correct pole selection based on local codes and standards for the job location. (See page 4).

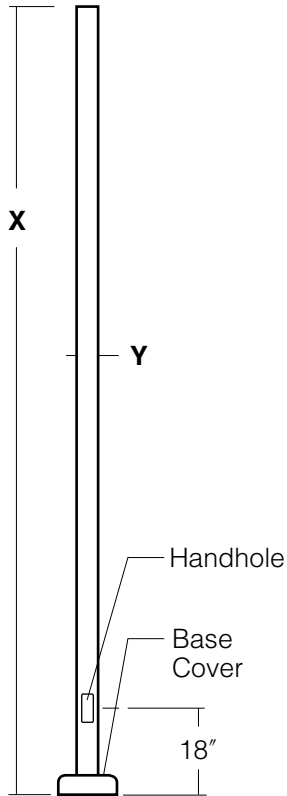

Pole Pole Catalog Number	X	Y	Allowable Pole EPA							Wind Map Steady Wind		
			85	90	100	110	120	130	140	150		
<input type="checkbox"/> KRS10-4120	10'	4" x 11 ga.	21.61	19.07	17.41	14.07	11.53	9.63	8.22	7.09		
<input type="checkbox"/> KRS12-4120	12'	4" x 11 ga.	17.33	15.22	13.84	11.05	8.94	7.28	6.26	5.37		
<input type="checkbox"/> KRS14-4120	14'	4" x 11 ga.	14.18	12.37	11.18	8.79	6.98	5.67	4.78	4.06		
<input type="checkbox"/> KRS16-4120	16'	4" x 11 ga.	11.72	10.13	9.09	7.01	5.42	4.30	3.58	3.01		
<input type="checkbox"/> KRS20-4120	19.5'	4" x 11 ga.	7.77	6.55	5.75	4.13	2.91	2.10	1.65	1.31		
<input type="checkbox"/> KRS20-4180	19.5'	4" x 7 ga.	12.67	10.92	9.77	7.46	5.70	4.48	3.70	3.09		
<input type="checkbox"/> KRS20-5120	19.5'	5" x 11 ga.	13.57	11.62	10.35	8.26	6.73	5.56	4.65	3.93		
<input type="checkbox"/> KRS20-5180	19.5'	5" x 7 ga.	21.60	18.79	16.94	13.71	11.31	9.47	8.02	6.86		
<input type="checkbox"/> KRS25-5120	25'	5" x 11 ga.	8.46	6.97	6.00	4.61	3.63	2.88	2.31	1.87		
<input type="checkbox"/> KRS25-5180	25'	5" x 7 ga.	14.59	12.44	11.03	8.77	7.12	5.86	4.88	4.10		
<input type="checkbox"/> KRS30-5180	30'	5" x 7 ga.	9.84	8.12	6.99	5.37	4.23	3.36	2.70	2.18		

Anchor Base and Bolt Detail

Pole Height	Pole Diameter	Bolt Circle DIA	Anchor Bolt Projection	Anchor Bolts Size	Base Cover Size	Conduit Opening
10'-16'	4"	7"-8 1/2"	3 3/8"	3/4" x 15" + 3"	11 7/8" DIA	3" DIA
19.5'	4"	7"-8 1/2"	3 3/8"	3/4" x 30" + 4"	11 7/8" DIA	3" DIA
19.5' - 30'	5"	7 1/2"-8 1/2"	3 3/8"	3/4" x 30" + 4"	11 7/8" DIA	3" DIA

Mounting

	Flush Mount	Post Top	Side Arm					
Plan Views:	●	●	●—	●—●	●—●—●	●—●—●—●	●—●—●—●—●	
Mounting ¹ :	<input type="checkbox"/> FM	<input type="checkbox"/> PT	<input type="checkbox"/> A <input type="checkbox"/> SA	<input type="checkbox"/> B <input type="checkbox"/> SB	<input type="checkbox"/> L <input type="checkbox"/> SL	<input type="checkbox"/> T <input type="checkbox"/> ST	<input type="checkbox"/> Y <input type="checkbox"/> SY	<input type="checkbox"/> C <input type="checkbox"/> SC

NOTE: Allowable Pole EPA for jobsite wind conditions must be equal to or greater than fixture mount EPA. Please refer to Kim luminaire catalog for specific fixture.

¹See luminaire drilling requirements in specific Kim luminaire catalog.

Type:


Job:

Standard and Optional Features

<p>Finish Super TGIC powder coat paint over an iron phosphate bath, chromate sealed metal pretreatment.¥</p>	<table border="0"> <tr> <td>Cat. No.:</td> <td>Color:</td> <td>Cat. No.:</td> <td>Color:</td> </tr> <tr> <td><input type="checkbox"/> BLS</td> <td>Black Gloss Smooth</td> <td><input type="checkbox"/> LGT</td> <td>Light Grey Matte Textured</td> </tr> <tr> <td><input type="checkbox"/> BLT</td> <td>Black Matte Textured</td> <td><input type="checkbox"/> PSS</td> <td>Platinum Silver Gloss Smooth</td> </tr> <tr> <td><input type="checkbox"/> DBS</td> <td>Dark Bronze Gloss Smooth</td> <td><input type="checkbox"/> VGT</td> <td>Verde Green Matte Textured</td> </tr> <tr> <td><input type="checkbox"/> DBT</td> <td>Dark Bronze Matte Textured</td> <td><input type="checkbox"/> WHS</td> <td>White Gloss Smooth</td> </tr> <tr> <td><input type="checkbox"/> GTT</td> <td>Graphic Matte Textured</td> <td><input type="checkbox"/> WHT</td> <td>White Matte Textured</td> </tr> <tr> <td><input type="checkbox"/> LGS</td> <td>Light Grey Gloss Smooth</td> <td><input type="checkbox"/> CC</td> <td>Custom Color¹</td> </tr> </table> <p>¹Custom color subject to additional charges, minimum quantities and extended lead times. Consult representative. Custom color description: _____</p>	Cat. No.:	Color:	Cat. No.:	Color:	<input type="checkbox"/> BLS	Black Gloss Smooth	<input type="checkbox"/> LGT	Light Grey Matte Textured	<input type="checkbox"/> BLT	Black Matte Textured	<input type="checkbox"/> PSS	Platinum Silver Gloss Smooth	<input type="checkbox"/> DBS	Dark Bronze Gloss Smooth	<input type="checkbox"/> VGT	Verde Green Matte Textured	<input type="checkbox"/> DBT	Dark Bronze Matte Textured	<input type="checkbox"/> WHS	White Gloss Smooth	<input type="checkbox"/> GTT	Graphic Matte Textured	<input type="checkbox"/> WHT	White Matte Textured	<input type="checkbox"/> LGS	Light Grey Gloss Smooth	<input type="checkbox"/> CC	Custom Color ¹
Cat. No.:	Color:	Cat. No.:	Color:																										
<input type="checkbox"/> BLS	Black Gloss Smooth	<input type="checkbox"/> LGT	Light Grey Matte Textured																										
<input type="checkbox"/> BLT	Black Matte Textured	<input type="checkbox"/> PSS	Platinum Silver Gloss Smooth																										
<input type="checkbox"/> DBS	Dark Bronze Gloss Smooth	<input type="checkbox"/> VGT	Verde Green Matte Textured																										
<input type="checkbox"/> DBT	Dark Bronze Matte Textured	<input type="checkbox"/> WHS	White Gloss Smooth																										
<input type="checkbox"/> GTT	Graphic Matte Textured	<input type="checkbox"/> WHT	White Matte Textured																										
<input type="checkbox"/> LGS	Light Grey Gloss Smooth	<input type="checkbox"/> CC	Custom Color ¹																										
<p>Optional Duplex Receptacle Cat. No. <input type="checkbox"/> DR <input type="checkbox"/> DR-GFI <input type="checkbox"/> No Option</p>	<p>Mounted opposite the handhole, at 22 1/2" from base of pole, in a cast aluminum box that is internally welded and sealed with a gasketed self-closing cover and locking bracket.</p> <p>Duplex Receptacle (DR) rated 20A., 125V. Duplex Receptacle with Ground Fault Circuit Interrupter (DR-GFI) rated 20A., 125V.</p>																												

Type:

Job:

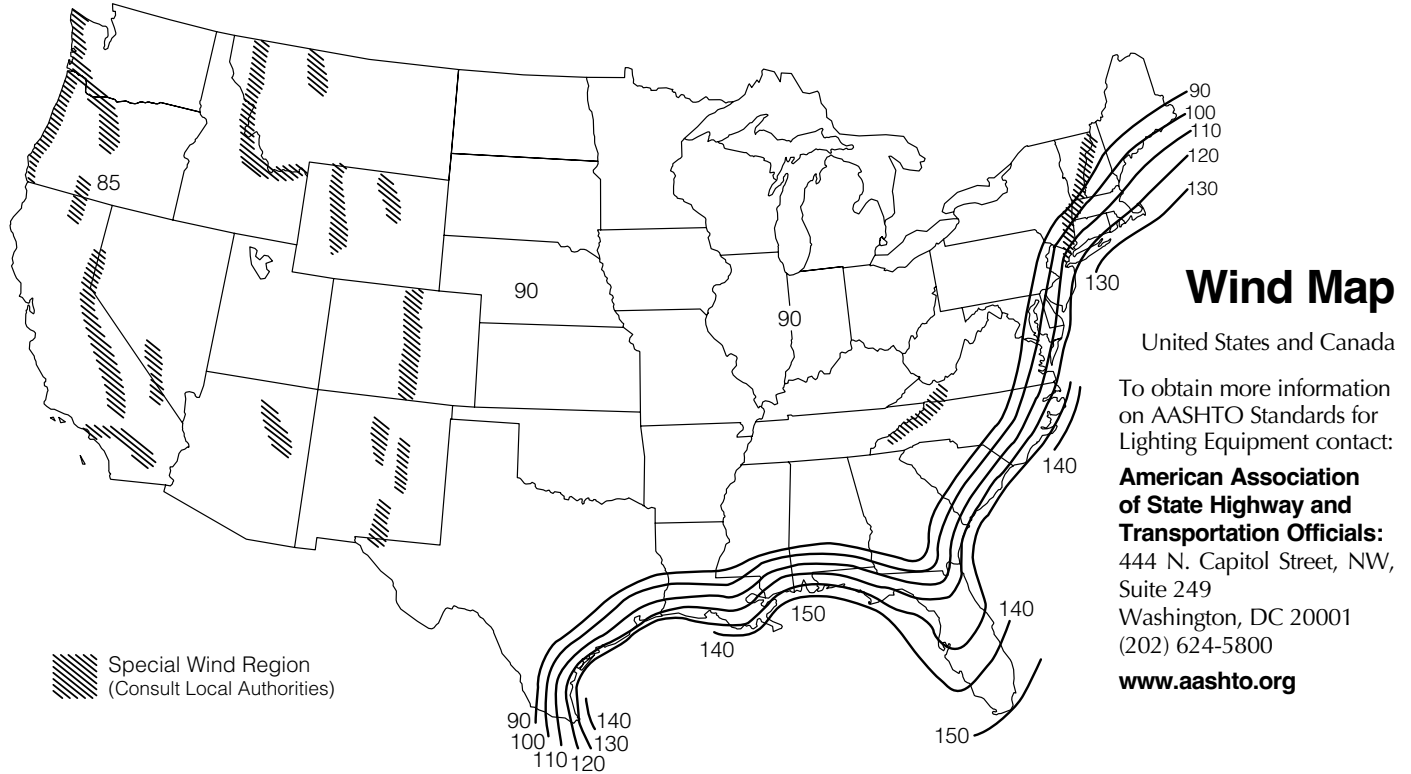

NOTES:

- Values are based on 50 year mean recurrence interval 30' above grade.
- Hawaii has an **105 mph** wind velocity.
- Puerto Rico has a **125 mph** wind velocity.
- Caution must be exercised in determining wind velocities in special wind areas such as:
 - Mountainous Regions
 - Areas surrounding the Great Lakes or other large bodies of water or open land.
 - Areas subject to extreme wind conditions, such as hurricanes, typhoons, cyclones, and tornadoes.
 - Areas adjacent to airports.
 - Any specific area with a known or suspected abnormally high intermittent wind condition caused by geography, adjacent structures, or other specific local conditions that may not be recorded in National Weather Service records.
- Allowable pole EPA for jobsite wind conditions must be equal to or greater than fixture EPA. Responsibility lies with the specifier for correct pole selection based on AASHTO wind map and job location.
- The Wind Map is intended only as a general guide. Always consult local authorities to determine maximum wind velocities, gusting and unique wind conditions for each specific application.
- **CAUTION:** Wind speeds and listed EPAs are for ground mounted installations. Poles mounted on structures (such as bridges and buildings) must consider vibration and coefficient of height factors beyond this general guide. Consult AASHTO standards.
- Extreme Wind Events: Hurricanes, Typhoons, Cyclones, or Tornadoes expose poles to flying debris, wind shear, and other unpredictable aerodynamic forces not indicated by the wind velocity ratings.
- Pole Strength Limited Warranty: Standard, unmodified Kim lighting Poles installed as recommended, undamaged by corrosion, or lack of maintenance, shall withstand steady wind conditions as provided on page 2 (Allowable Pole EPA). Installation of poles without luminaires, or attachment of any unauthorized accessories to poles shall void this warranty.