

PRA





ROUND ALUMINUM NON-TAPERED POLE

Type:
Job:
Catalog number:

Approvals:

Pole	/	/	/	/	/
See page 2	Mounting	Structural Luminaire Option	Finish	Optional Hinged Base	Optional Duplex Receptacle
	See page 3			See page 4	

Specifications

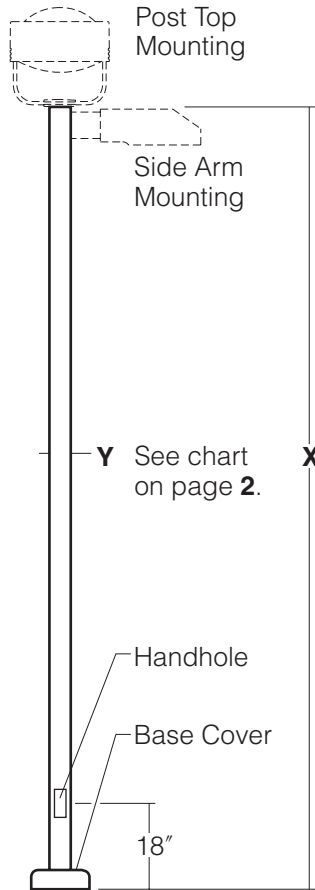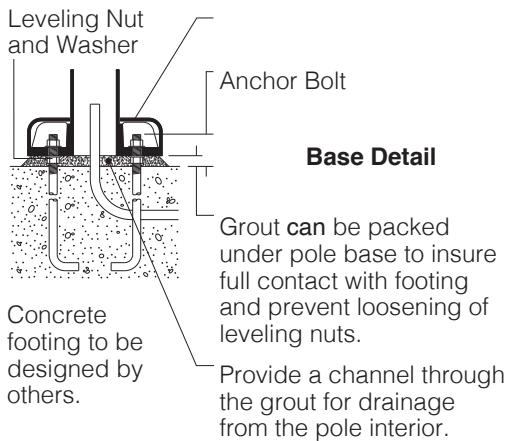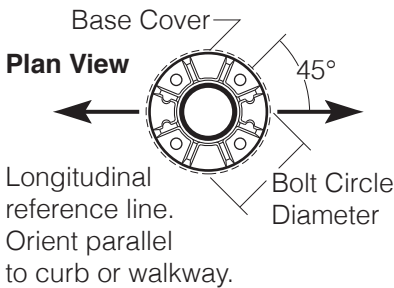

Pole Construction: Seamless round extruded aluminum tube of alloy 6061-T6, welded to top and bottom of aluminum base casting of alloy 356.

Base Cover: Base has a two-piece cast aluminum full cover of 319 alloy, secured by stainless steel screws.

Pole Cap: A flush-sided cast aluminum pole cap is provided for side arm mounted luminaires.

Handhole: 18" up from base, with a gasketed cover and ground lug.

Anchor Bolts: Four galvanized anchor bolts provided, complete with eight nuts, eight flat washers, and a presswood template.

Vibration Dampener: All poles 25' and above include an internally mounted, factory installed pendulum vibration dampener, with flush stainless steel socket head fasteners finished to match pole.

Strength: Poles will withstand wind loads as listed in chart (See page 2) when luminaires are mounted per fixture installation instructions.

Finish: Durable thermoset polyester powder coat paint finish with nominal 3.0 mil thickness. Decorative finish coat available in multiple standard colors; Custom colors available, RAL number preferred.

CAUTION: Installation of poles without luminaire(s) will compromise pole strength. Any accessories attached to pole, or other modifications will compromise pole strength and may result in pole failure.

Maintenance: A regularly scheduled maintenance program must be established to insure the protective paint coating is intact, corrosion or structural damage has not occurred, and anchor bolt nuts are tight. Failure to do so could lead to pole collapse and serious personal injury.

Certification: Certified UL 1598 in accordance with Article 410 of ANSI/NFPA 70, National Electrical Code.


PRA

ROUND ALUMINUM NON-TAPERED POLE

Standard Features


NOTE: All allowable pole and fixture EPAs are derived from the AASHTO standard. Responsibility lies with the specifier for correct pole selection based on local codes and standards for the job location. (See page 4).

Pole – Pole Catalog Number	X	Y	Wind Map Steady Wind								
			85	90	100	110	120	130	140	150	
PRA8-4125	8'	4" x .125	13.06	11.49	10.46	8.39	6.81	5.65	4.80	4.13	
PRA8-5125	8'	5" x .125	21.29	18.79	17.15	14.05	11.72	9.92	8.49	7.34	
PRA10-4125	10'	4" x .125	9.78	8.53	9.09	7.01	5.42	4.30	3.58	3.01	
PRA10-5125	10'	5" x .125	16.21	14.21	12.90	10.51	8.72	7.34	6.25	5.38	
PRA12-4125	12'	4" x .125	7.48	6.44	5.75	4.37	3.32	2.59	2.14	1.78	
PRA12-5125	12'	5" x .125	12.67	11.00	9.91	8.01	6.60	5.51	4.66	3.99	
PRA12-6188	12'	6" x .188	32.89	29.22	27.04	22.20	18.53	15.69	13.44	11.64	
PRA14-4125	14'	4" x .125	5.73	4.84	4.25	3.06	2.16	1.57	1.24	0.98	
PRA14-4188	14'	4" x .188	10.56	9.14	8.21	6.34	4.92	3.91	3.26	2.74	
PRA14-5125	14'	5" x .125	10.01	8.58	7.64	6.10	4.98	4.11	3.44	2.91	
PRA14-5188	14'	5" x .188	17.90	15.62	14.12	11.46	9.48	7.95	6.75	5.79	
PRA14-6188	14'	6" x .188	27.19	24.11	22.37	18.31	15.24	12.87	11.00	9.49	
PRA16-4188	16'	4" x .188	8.55	7.31	6.50	4.86	3.62	2.76	2.25	1.85	
PRA16-5125	16'	5" x .125	7.90	6.65	5.83	4.57	3.67	2.98	2.45	2.03	
PRA16-5188	16'	5" x .188	14.80	12.81	11.50	9.26	7.61	6.34	5.34	4.55	
PRA16-6188	16'	6" x .188	22.77	20.16	18.75	15.29	12.69	10.68	9.09	7.82	
PRA20-4188	19.5'	4" x .188	5.33	4.37	3.74	2.48	1.52	0.91	0.63	0.42	
PRA20-5125	19.5'	5" x .125	4.50	3.54	2.90	2.11	1.56	1.16	0.85	0.62	
PRA20-5188	19.5'	5" x .188	9.83	8.29	7.28	5.73	4.60	3.75	3.09	2.56	
PRA20-6188	19.5'	6" x .188	15.69	13.81	12.95	10.46	8.59	7.16	6.03	5.14	
PRA25-6188	25'	6" x .188	9.74	8.46	8.07	6.38	5.12	4.17	3.43	2.85	
PRA30-6188	30'	6" x .188	5.61	4.74	4.69	3.54	2.71	2.08	1.60	1.23	
PRA30-6250	30'	6" x .250	11.37	9.88	9.42	7.45	5.99	4.88	4.02	3.34	

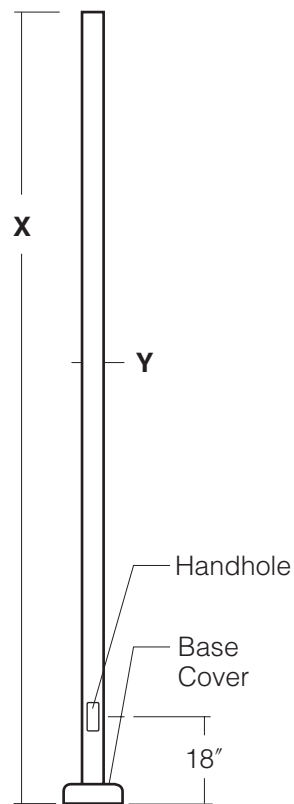

Standard Features


NOTE: All allowable pole and fixture EPAs are derived from the AASHTO standard. Responsibility lies with the specifier for correct pole selection based on local codes and standards for the job location. (See page 5).

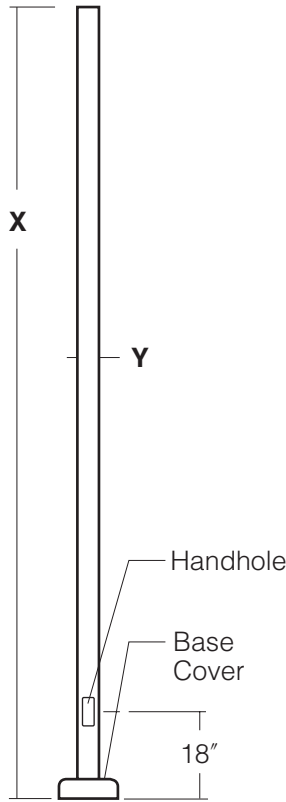

Anchor Base and Bolt Detail\$

Pole Height	Pole Diameter	Bolt Circle Dia.	Anchor Bolt Projection	Anchor Bolts Size	Base Cover Size	Conduit Opening
8'-14'	4"	8 1/2"	3 1/4"	3/4" x 15" + 3"	11 7/8"	3" dia.
8'-14'	5"	8 1/2"	3 1/4"	3/4" x 30" + 4"	11 7/8"	3" dia.
12'	6"	10 1/2"	3 1/4"	3/4" x 30" + 4"	11 7/8"	3" dia.
14'	6"	10 1/2"	3 1/4"	3/4" x 30" + 4"	11 7/8"	3" dia.
16'-20'	4"-5"	8 1/2"	3 1/4"	3/4" x 30" + 4"	11 7/8 E"	3" dia.
16'-20'	6"	10 1/2"	3 3/8"	3/4" x 30" + 4"	14"	5" dia.
25'-30'	6"	10 1/2"	3 3/8"	3/4" x 30" + 4"	14"	5" dia.

Mounting

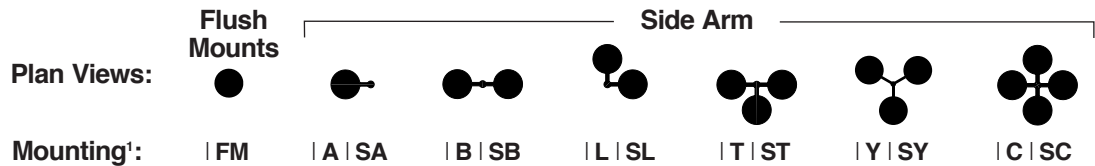

NOTE: Allowable Pole EPA for jobsite wind conditions must be equal to or greater than fixture mount EPA. Please refer to Kim luminaire catalog for specific fixture.

¹See luminaire drilling requirements in luminaire catalog.

Structural Luminaires Only - Examples


- | **TS**: Single Tension for small and large Structural - PRA20-5188SB-TS
- | **TD**: Double Tension for small and large Structural - PRA20-5188B-TD
- | **TR**: Truss for small and large Structural - PRA20-5188SB-TR
- | **XTS**: Single Tension for 1000W Structural - PRA20-5188B-XTS
- | **XTD**: Double Tension for 1000W Structural - PRA20-5188B-XTD
- | **XTR**: Truss for 1000W Structural - PRA20-5188B-XTR

Standard and Optional Features

<p>Finish TGIC powder coat paint over a titanated zirconium conversion coating.</p>	<table border="0"> <tr> <td>Cat. No.:</td> <td>Color:</td> <td>Cat. No.:</td> <td>Color:</td> </tr> <tr> <td> BLS</td> <td>Black Gloss Smooth</td> <td> LGT</td> <td>Light Grey Matte Textured</td> </tr> <tr> <td> BLT</td> <td>Black Matte Textured</td> <td> PSS</td> <td>Platinum Silver Gloss Smooth</td> </tr> <tr> <td> DBS</td> <td>Dark Bronze Gloss Smooth</td> <td> VGT</td> <td>Verde Green Matte Textured</td> </tr> <tr> <td> DBT</td> <td>Dark Bronze Matte Textured</td> <td> WHS</td> <td>White Gloss Smooth</td> </tr> <tr> <td> GTT</td> <td>Graphic Matte Textured</td> <td> WHT</td> <td>White Matte Textured</td> </tr> <tr> <td> LGS</td> <td>Light Grey Gloss Smooth</td> <td> CC</td> <td>Custom Color¹</td> </tr> </table> <p>¹Custom color subject to additional charges, minimum quantities and extended lead times. Consult representative. Custom color description: _____</p>	Cat. No.:	Color:	Cat. No.:	Color:	BLS	Black Gloss Smooth	LGT	Light Grey Matte Textured	BLT	Black Matte Textured	PSS	Platinum Silver Gloss Smooth	DBS	Dark Bronze Gloss Smooth	VGT	Verde Green Matte Textured	DBT	Dark Bronze Matte Textured	WHS	White Gloss Smooth	GTT	Graphic Matte Textured	WHT	White Matte Textured	LGS	Light Grey Gloss Smooth	CC	Custom Color ¹
Cat. No.:	Color:	Cat. No.:	Color:																										
BLS	Black Gloss Smooth	LGT	Light Grey Matte Textured																										
BLT	Black Matte Textured	PSS	Platinum Silver Gloss Smooth																										
DBS	Dark Bronze Gloss Smooth	VGT	Verde Green Matte Textured																										
DBT	Dark Bronze Matte Textured	WHS	White Gloss Smooth																										
GTT	Graphic Matte Textured	WHT	White Matte Textured																										
LGS	Light Grey Gloss Smooth	CC	Custom Color ¹																										
<p>Optional Duplex Receptacle Cat. No. DR DR-GFI No Option</p>	<p>Mounted opposite the handhole, at 22-1/2" from base of pole, in a cast aluminum box that is internally welded and sealed with a gasketed self-closing cover and locking bracket.</p> <p>Duplex Receptacle (DR) rated 20A., 125V. Duplex Receptacle with Ground Fault Circuit Interrupter (DR-GFI) rated 20A., 125V.</p>																												

Type:

Job:

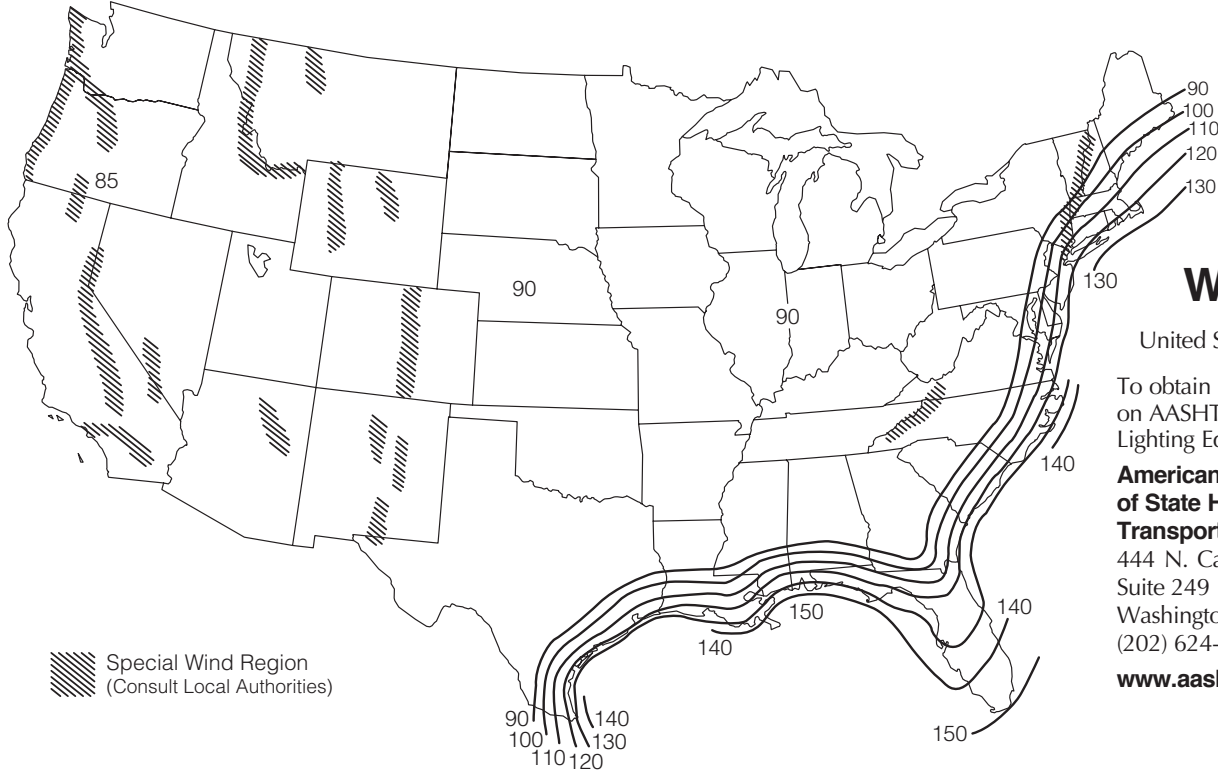

Wind Map

United States and Canada

To obtain more information on AASHTO Standards for Lighting Equipment contact:

American Association of State Highway and Transportation Officials:
 444 N. Capitol Street, NW,
 Suite 249
 Washington, DC 20001
 (202) 624-5800

www.aashto.org

NOTES:

- Values are based on 50 year mean recurrence interval 30' above grade.
- Hawaii has an **105 mph** wind velocity.
- Puerto Rico has a **125 mph** wind velocity.
- Caution must be exercised in determining wind velocities in special wind areas such as:
 - Mountainous Regions
 - Areas surrounding the Great Lakes or other large bodies of water or open land.
 - Areas subject to extreme wind conditions, such as hurricanes, typhoons, cyclones, and tornadoes.
 - Areas adjacent to airports.
 - Any specific area with a known or suspected abnormally high intermittent wind condition caused by geography, adjacent structures, or other specific local conditions that may not be recorded in National Weather Service records.
- Allowable pole EPA for jobsite wind conditions must be equal to or greater than fixture EPA. Responsibility lies with the specifier for correct pole selection based on AASHTO wind map and job location.
- The Wind Map is intended only as a general guide. Always consult local authorities to determine maximum wind velocities, gusting and unique wind conditions for each specific application.
- **CAUTION:** Wind speeds and listed EPAs are for ground mounted installations. Poles mounted on structures (such as bridges and buildings) must consider vibration and coefficient of height factors beyond this general guide. Consult AASHTO standards.
- Extreme Wind Events: Hurricanes, Typhoons, Cyclones, or Tornadoes expose poles to flying debris, wind shear, and other unpredictable aerodynamic forces not indicated by the wind velocity ratings.
- Pole Strength Limited Warranty: Standard, unmodified Kim lighting Poles installed as recommended, undamaged by corrosion, or lack of maintenance, shall withstand steady wind conditions as provided on page 2 (Allowable Pole EPA). Installation of poles without luminaires, or attachment of any unauthorized accessories to poles shall void this warranty.