


**NOTES:**

1. Disconnect Line Voltage prior to installation or servicing the Room Controllers.
2. A NXRC-UL924 Room Controller must be connected to a standard NX Room Controller Smart Port. Limit one NX UL924 Room Controller per Smart Port.
3. No Input Control Device should be connected to the NXRC-UL924 Device.
4. During Normal conditions both Room Controllers will function together and per programming.
  - 4.1. When Normal Power is lost, the NXRC-UL924 Controller will default to non-controlled ON state, until normal power is restored.
  - 4.2. When Normal Power is lost, the NXRC-UL924 dimmed channels will maintain 100% output until normal power is restored.

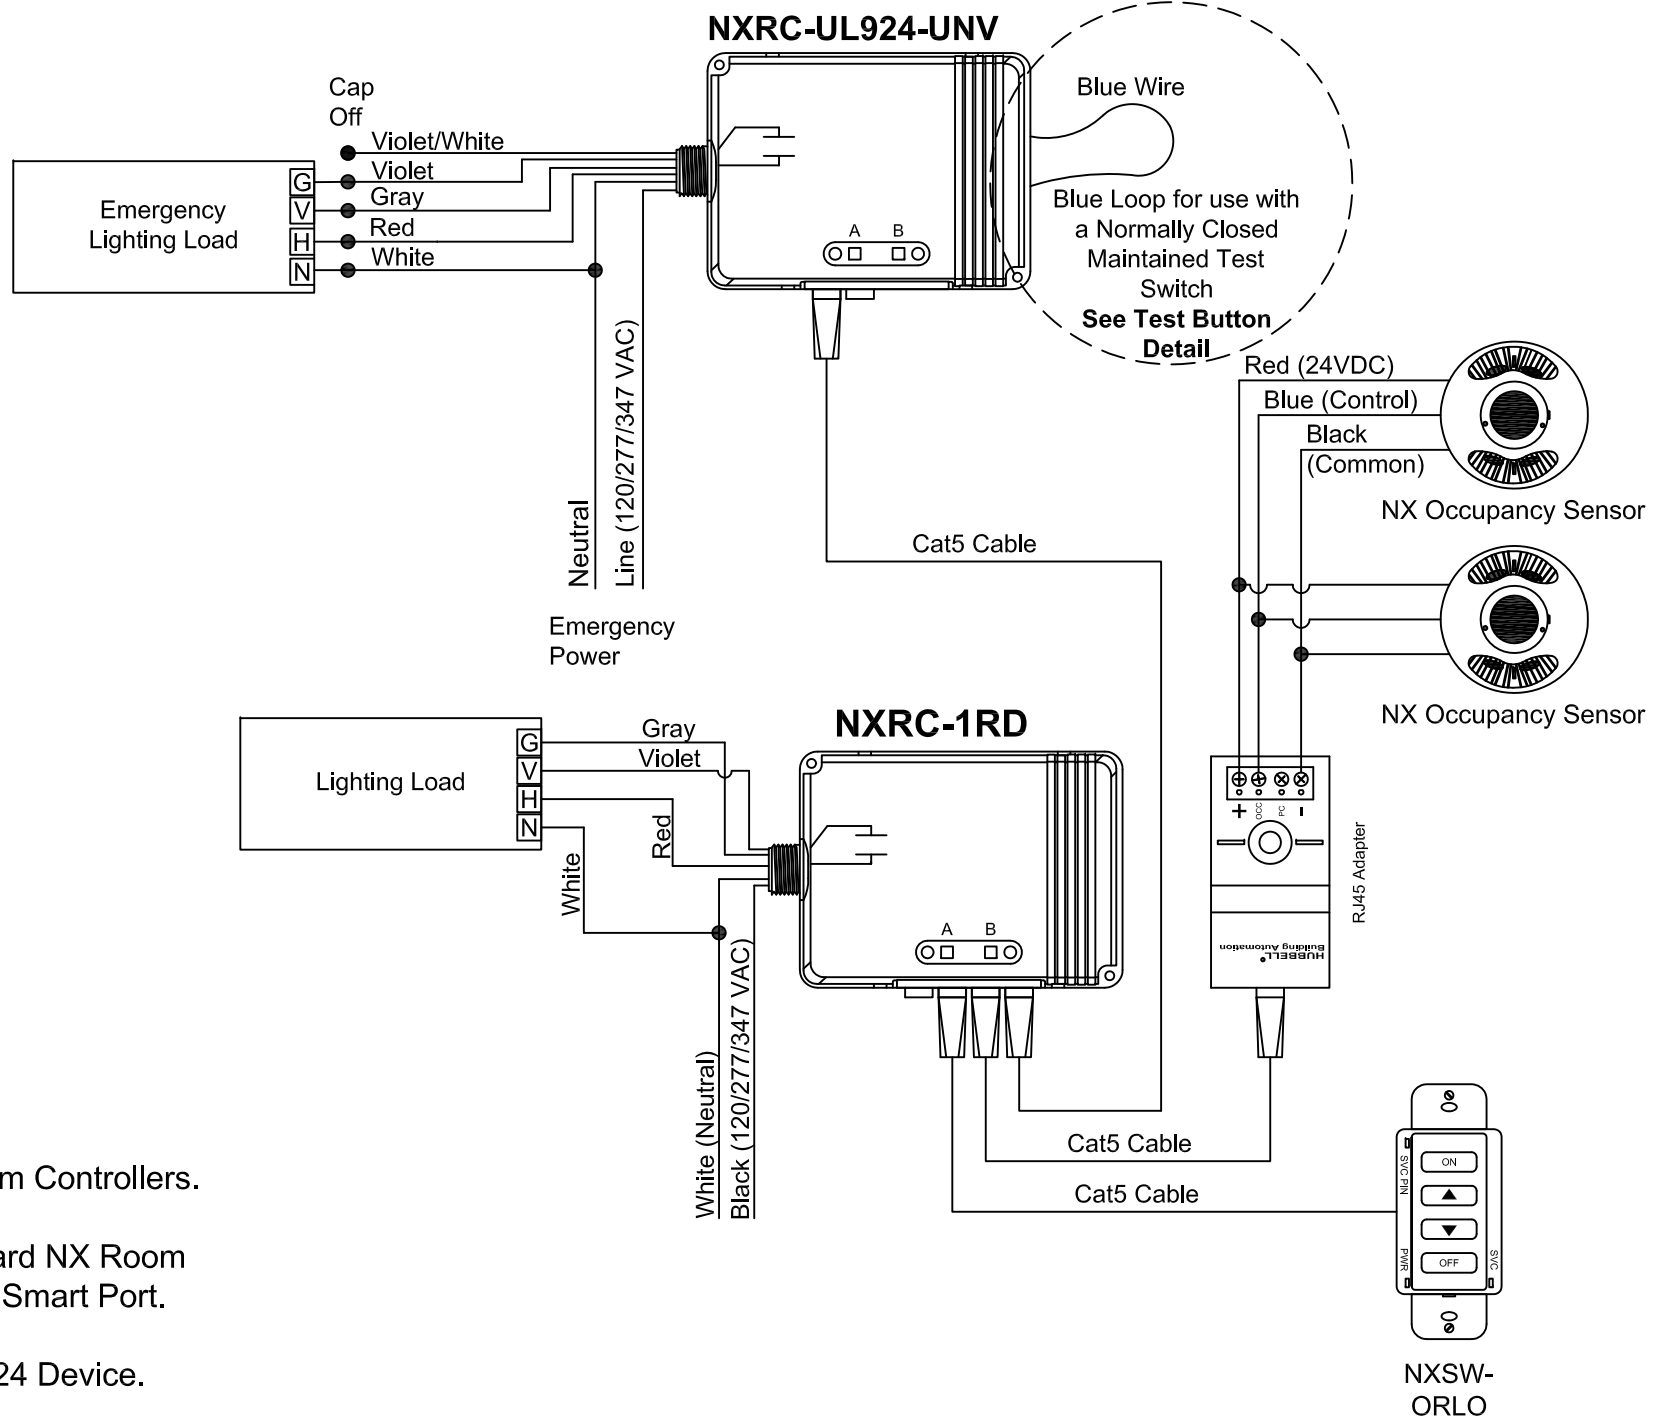

TITLE: <b>NXRC-UL924-UNV, NXRC-1RD, OMNI, SW-ORLO</b>	
 <b>HUBBELL</b> Control Solutions	THIS DOCUMENT AND SPECIFICATIONS DESCRIBED WITHIN ARE THE EXCLUSIVE PROPERTY OF HUBBELL CONTROL SOLUTIONS ISSUED IN THE STRICTEST CONFIDENCE, AND SHALL NOT BE REPRODUCED, COPIED OR USED WITHOUT PRIOR WRITTEN PERMISSION.
	DRAWN BY: <b>AJ</b> DATE: <b>11/08/2019</b> PRODUCT FAMILY: <b>HCS</b>
701 Millennium Blvd. Greenville, SC 29607 www.Hubbell-Automation.com	Main Switchboard: (864) 678-1000 Technical Service: (800) 888-8006