



Hubbell Control Solutions  
Low Voltage Sensors(devices)  
**Requires 33mA each**

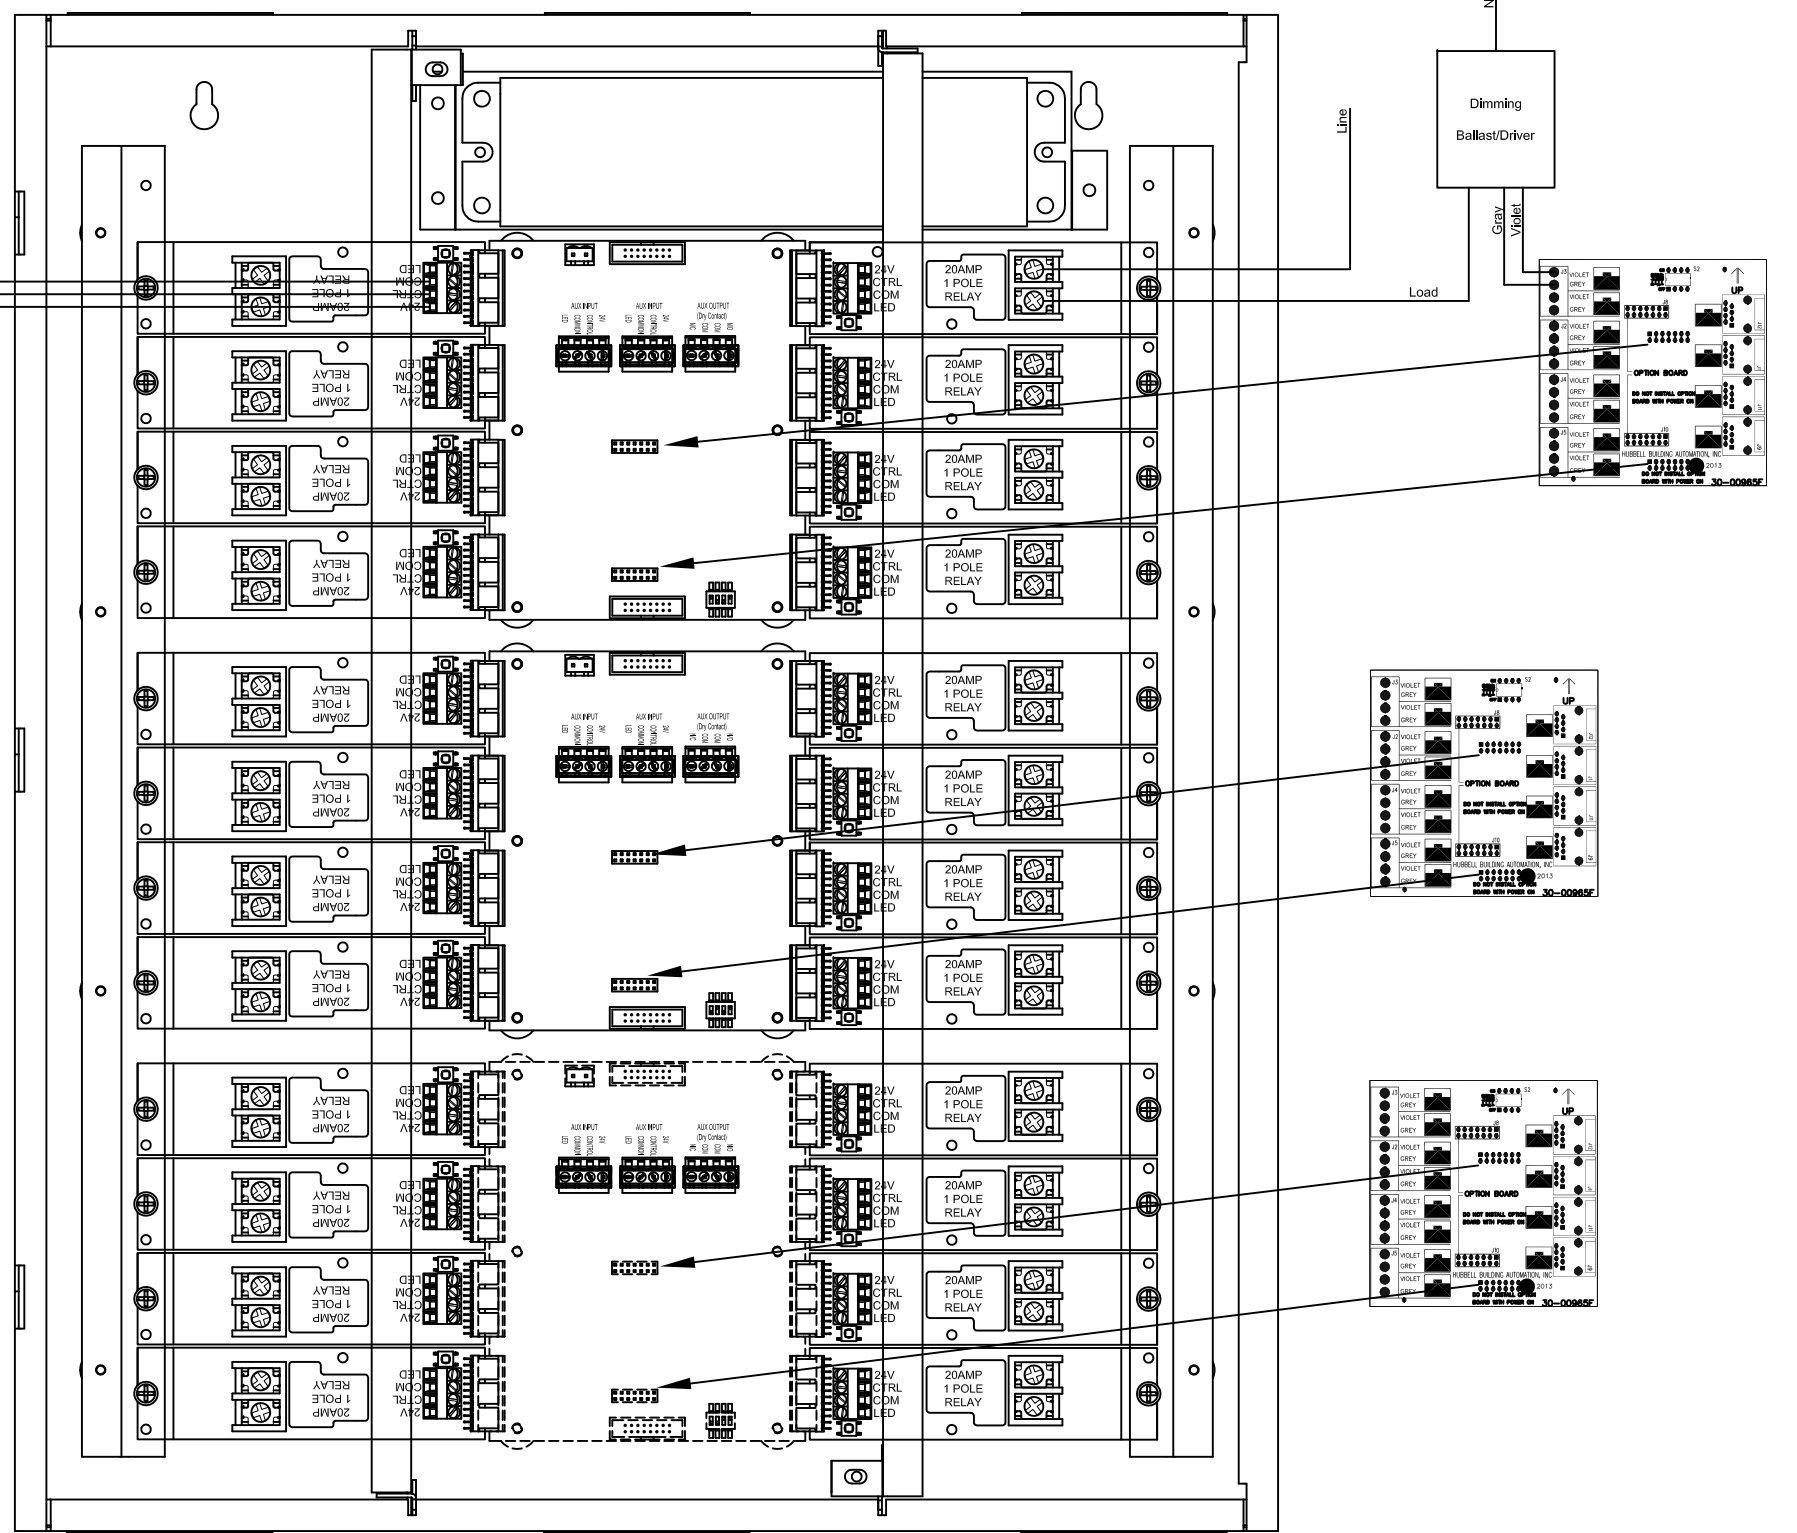

**CX16/CX24**

**NOTES:**

1. Caution: ALWAYS remove supply power to the Panel control Transformer prior to making any connections between dimming boards and panel processor board. Failure to do so may result in personnel injury, damage to the panel, and void its warranty.
2. Locate Option connectors on CX CPU Board. Verify Key alignment and firmly press board into place.
3. CX16/24 (Note -On the CX16 the third CPU board and relays 17-24 are not present).

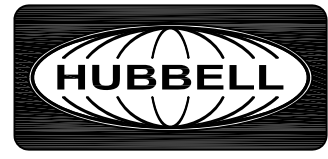

**HUBBELL**  
Control Solutions

**CX16/24 Control Panel with Dimming Card and Occupancy Sensor**

THIS DOCUMENT AND SPECIFICATIONS DESCRIBED WITHIN ARE THE EXCLUSIVE PROPERTY OF HUBBELL CONTROL SOLUTIONS ISSUED IN THE STRICTEST CONFIDENCE, AND SHALL NOT BE REPRODUCED, COPIED OR USED WITHOUT PRIOR WRITTEN PERMISSION.